



**NEMO|etc.**

Certificate of Authorization #32455  
353 Christian Street, Unit #13  
Oxford, CT 06478  
(203) 262-9245

ENGINEER

TEST

CONSULT

**P.E. EVALUATION REPORT (PEER)**

**Mule-Hide Products Co., Inc.**

1195 Prince Hall Drive, Suite A  
Beloit, WI 53511  
**(608) 365-3111**

**PEER-MHP-002.A-R2**

**FL41940-R2 (NON-HVHZ)**

Date of Issuance: 02/13/2023

**Revision 2: 04/25/2024**

**SCOPE:**  
This P.E. Evaluation Report (henceforth 'PEER') is issued under **F.A.C. Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The product described herein has been evaluated for compliance with the **8<sup>th</sup> Edition (2023) Florida Building Code sections noted herein.**

**DESCRIPTION: Mule-Hide Roof Underlayments (NON-HVHZ)**

**LABELING:** Labeling shall be in accordance with the requirements the Accredited Quality Assurance Agency noted herein and [FBC 1507.1.1](#).


**CONTINUED COMPLIANCE:** This PEER is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our PEERs by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance or the production facility location(s). NEMO ETC, LLC requires a complete review of its PEER relative to updated Code requirements with each Code Cycle.

**ADVERTISEMENT:** The Florida Product Approval Number (FL#) preceded by the words "NEMO P.E. Evaluated" may be displayed in advertising literature. If any portion of the PEER is displayed, then it shall be done in its entirety.

**INSPECTION:** Upon request, a copy of this entire PEER shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This PEER consists of pages 1 through 12.

**Prepared by:**

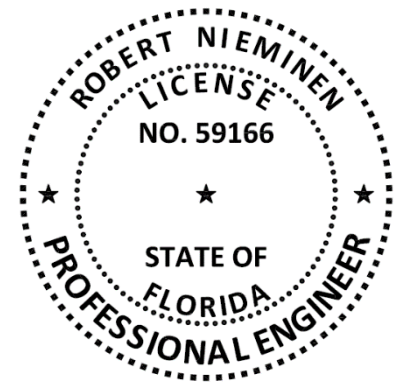

**CERTIFICATION OF INDEPENDENCE:**

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the PEERs are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

**ROOFING COMPONENT EVALUATION:**
**1. SCOPE:**

**Product Category:** Roofing  
**Sub-Category:** Underlayment  
**Product Approval Method:** Method 1, Option D – Codified Material, Evaluation by Engineer  
**Compliance Statement:** Mule-Hide Roof Underlayments, as produced by Mule-Hide Products Co., Inc., have demonstrated compliance with the following sections of the 8<sup>th</sup> Edition (2023) Florida Building Code through testing in accordance with the following Standards. Compliance is subject to the [Installation Requirements](#) and [Limitations of Use](#) set forth herein.

**2. STANDARDS:**

SECTION	PROPERTY	STANDARD
1504.2.1.4	Wind resistance	UL 1897
1504.7	Impact resistance	ASTM D3746
1507.1.1 / R905.1.1	Material standard	ASTM D226
1507.1.1, 1507.2.9.2 / R905.1.1, R905.2.8.2	Material standard	ASTM D1970
1507.3.3 / R905.3.3	Material standard	FRSA/TRI, Seventh Edition
1507.11.2 / R905.11.2	Material standard	ASTM D6163
1507.11.2 / R905.11.2	Material standard	ASTM D6222
TAS 110	Accelerated Weathering	ASTM D4798
TAS 110	Material Standard	TAS 103

**3. REFERENCES:**

ENTITY	EXAM	REFERENCE	DATE
NEMO	PEER	PEER-PLYG-002.A.R39	02/21/2024
NEMO	Traceability	FBC Cross-Listing Agreement	02/13/2023
NEMO	Traceability	FBC Cross-Listing Agreement	04/16/2024
UL (QUA9625)	Quality Control	Service Confirmation	02/07/2023

**4. PRODUCT DESCRIPTION:**
**TABLE 1: EVALUATED UNDERLAYMENTS**

PRODUCT	MATERIAL STANDARD	PLANT(S)	DESCRIPTION
Nail Base	ASTM D6163	FL	Fiberglass-reinforced, SBS modified bitumen base sheet
APP Torch G Premier	ASTM D6222 FRSA/TRI	FL	Polyester-reinforced, APP modified bitumen cap sheet
APP Torch G FR Premier	ASTM D6222 FRSA/TRI	FL	Polyester-reinforced, APP modified bitumen cap sheet
SA-APP Cap Sheet	ASTM D6222 FRSA/TRI	FL, TX	Polyester-reinforced, APP modified bitumen cap sheet
SA-APP Cap Sheet FR	ASTM D6222 FRSA/TRI	FL, TX	Polyester-reinforced, APP modified bitumen cap sheet
Shur-Gard MU Force HT	ASTM D1970 FRSA/TRI, TAS 103	FL, NV, PA, TX, Ponte de Piave TV (Italy)	Nominal 60-mil thick rubberized asphalt waterproofing membrane, glass fiber reinforced, surfaced with polyolefinic film surface
Shur-Gard TU Prime HT (fka, Shur-Gard TU Ultra HT)	ASTM D1970 FRSA/TRI, TAS 103	FL, PA, TX	Nominal 60-mil thick rubberized asphalt waterproofing membrane with a 190 g/m <sup>2</sup> polyester fabric surface
Shur-Gard TU Force HT	ASTM D1970 FRSA/TRI, TAS 103	FL, PA, TX, Ponte de Piave TV (Italy)	Nominal 80-mil thick rubberized asphalt waterproofing membrane, glass fiber reinforced, with a polyester fabric surface

**5. LIMITATIONS:**

- 5.1 This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance. PEERs are not to be construed as representing any attributes not specifically listed, nor are PEERs to be construed as an endorsement of the subject, or a recommendation for its use. There is no warranty by NEMO ETC, LLC or Robert Nieminen, P.E., express or implied, as to any finding or other matter in this PEER, or as to any product covered by the PEER.
- 5.2 This PEER is not for use in FBC High Velocity Hurricane Zone jurisdictions, as defined in FBC Chapter 2 (Broward and Miami-Dade Counties).
- 5.3 This PEER pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.4 This PEER does not include evaluation of fire classification. Refer to **FBC 1505** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.
- 5.5 **Mule-Hide Roof Underlayments** may be used with any prepared roof cover where the product is specifically referenced within FBC approval documents. If not listed, a request may be made to the Authority Having Jurisdiction for approval based on this evaluation combined with supporting data for the prepared roof covering.
- 5.6 Allowable Roof Covers:

TABLE 2: ROOF COVER OPTIONS						
<u>FBC NON-HVHZ:</u>	1507.2	1507.3		1507.4 & 1507.5	1507.7	1507.8 & 1507.9
UNDERLAYMENT	ASPHALT SHINGLES	CLAY AND CONCRETE TILE		METAL	SLATE OR SLATE-TYPE SHINGLES	WOOD
		MECHANICAL ATTACH	ADHESIVE-SET			
Nail Base	Yes (Alternate to D226, Type II)	Yes (as Base Sheet, See <a href="#">Table 4B</a> )	Yes (as Base Sheet, See <a href="#">Table 4B</a> )	Yes (Alternate to D226, Type II)	Yes (Alternate to D226, Type II)	Yes (Alternate to D226, Type II)
APP Torch G Premier	No	Yes	Yes ( <a href="#">Table 2A</a> )	No	No	No
APP Torch G FR Premier	No	Yes	No	No	No	No
SA-APP Cap Sheet	No	Yes	Yes ( <a href="#">Table 2A</a> )	No	No	No
SA-APP Cap Sheet FR	No	Yes	Yes ( <a href="#">Table 2A</a> )	No	No	No
Shur-Gard MU Force HT	Yes	Yes	No	Yes	Yes	Yes <sup>1</sup>
Shur-Gard TU Prime HT	No	Yes	Yes ( <a href="#">Table 2A</a> )	Yes	No	Yes <sup>1</sup>
Shur-Gard TU Force HT	Yes	Yes	Yes ( <a href="#">Table 2A</a> )	Yes	Yes	Yes <sup>1</sup>

- 5.6.1 Adhesive-set tile is limited to use of the following underlayment / tile-adhesive combinations.

TABLE 2A: ALLOWABLE UNDERLAYMENT / TILE-ADHESIVE COMBINATIONS <sup>2</sup>					
UNDERLAYMENT	TILE-ADHESIVE OPTIONS AND <a href="#">FLORIDA PRODUCT APPROVAL</a>				
	DAP GLOBAL		DUPONT DE NEMOURS	ICP CONSTRUCTION	
	STORMBOND	STORMBOND 2	TILE BOND	POLYSET AH-160	POLYSET RTA-1
	FL14506	FL14506	FL22525	FL6332	FL6276
APP Torch G Premier	No	No	No	No	Yes
SA-APP Cap Sheet	Yes	Yes	Yes	Yes	Yes
SA-APP Cap Sheet FR	No	No	No	No	Yes

<sup>1</sup> Used as min. 3 ¼-inch wide joint-strips per FBC 1507.1.1.1(2) / FBC R905.1.1.1(2) or installed in full-coverage atop ASTM D226, Type II felt or Nail Base, mechanically attached in accordance with FBC Table 1507.1.1.1 or FBC Residential Table R905.1.1.1

<sup>2</sup> Refer to Tile Manufacturer's or Adhesive Manufacturer's Florida Product Approval for Overturning Moment Resistance Performance.

TABLE 2A: ALLOWABLE UNDERLAYMENT / TILE-ADHESIVE COMBINATIONS <sup>2</sup>					
UNDERLAYMENT	TILE-ADHESIVE OPTIONS AND <a href="#">FLORIDA PRODUCT APPROVAL</a>				
	DAP GLOBAL		DUPONT DE NEMOURS	ICP CONSTRUCTION	
	STORMBOND	STORMBOND 2	TILE BOND	POLYSET AH-160	POLYSET RTA-1
	FL14506	FL14506	FL22525	FL6332	FL6276
Shur-Gard TU Prime HT	Yes	Yes	Yes	Yes	Yes
Shur-Gard TU Force HT	Yes	Yes	Yes	Yes	Yes

5.7 Allowable Substrates:

TABLE 3: SUBSTRATE OPTIONS FOR ADHERED UNDERLAYMENTS				
UNDERLAYMENT	APPLICATION	SUBSTRATES (DESIGNED TO MEET WIND LOADS FOR PROJECT)		
		TYPE	PRIMER	MATERIAL(S)
Shur-Gard MU Force HT, Shur-Gard TU Prime HT, Shur-Gard TU Force HT, SA-APP Cap Sheet or SA-APP Cap Sheet FR	self-adhering	Deck / sheathing	(Optional) ASTM D41	plywood, OSB, Southern Yellow Pine or Huber Engineered Woods "ZIP System" Panels
			ASTM D41	structural concrete
		Insulation	(Optional) ASTM D41	ASTM C1289 Type II Class 1 polyisocyanurate, ASTM C1289 Type V polyisocyanurate-composite, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board
		Base Sheet	N/A	ASTM D226, Type II felt or Nail Base
APP Torch G Premier or APP Torch G FR Premier	torch-applied	Deck	ASTM D41	structural concrete
		Insulation	(Optional) ASTM D41	DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board
		Base Sheet	N/A	Nail Base

5.8 Attachment Limitations:

5.8.1 For use under mechanically attached NON-TILE prepared roof coverings, attachment shall be in accordance with the manufacturer's installation instructions subject to the following limitations:

- For mechanically attached underlayments or base sheets over wood sheathing, attachment shall be not less than **FBC 1507.1.1** or **R905.1.1**.
- For mechanically attached underlayments or base sheets over insulated steel deck, fasteners shall consist of FBC Approved steel-deck roofing screws fitted with stress plates (Category: Roofing; Subcategory: Roofing Fasteners), spaced as noted in **1507.1.1** or **R905.1.1**. Screws and stress plates shall come from the same Product Manufacturer.

5.8.2 Wind Resistance for Underlayment Systems in Tile Roof Applications:

The following wind uplift limitations apply to tile underlayment systems. The Maximum Design Pressure ('MDP') is the result of testing for wind load resistance based on allowable wind loads, and reflects the ultimate passing pressure divided by 2 (the 2 to 1 margin of safety per **FBC 1504.9** has already been applied).

5.8.2.1 Adhered, Direct-to-Deck Underlayment Systems:

The maximum design pressure for the selected assembly shall meet or exceed that required under **FRSA/TRI Manual, 7th Edition**, Appendix A or the critical (highest) design pressure determined in accordance with **FBC 1609** or **FBC Residential Chapter 3**.

**TABLE 4A: ALLOWABLE DESIGN PRESSURES,**
**ADHERED, DIRECT-TO-DECK UNDERLAYMENT SYSTEMS IN TILE ROOF APPLICATIONS**
*\*Nails shall be corrosion resistant and be of sufficient length to penetrate through the sheathing by min. 3/16-inch*

SYSTEM No.	DECK	PRIMER	JOINT TREATMENT	BASE PLY	CAP PLY	MDP (PSF)
UDL-1.	OSB, APA rated sheathing, 24/16, Exposure 1, PS2, 7/16 category	None	Min. 4-inch wide strips of SA Base Sheet	Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-52.5
UDL-2.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category or nominal 1-inch SYP wood plank	None	None	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-90.0
UDL-3.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) 121 Asphalt Primer or ASTM D41	Min. 4-inch wide strips of SA Base Sheet	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-135.0
UDL-4.	Nominal 1-inch wood plank	(Optional) 121 Asphalt Primer or ASTM D41	None	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-150.0
UDL-5.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	None	None	None	Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed within the selvedge-edge side laps using min. 12 ga. x 3/8" head diameter ring shank nails* through 32 ga., 1-5/8" diameter tin caps spaced 12-inch o.c.	-165.0
UDL-6.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) 121 Asphalt Primer at 0.5 gal/sq.	None	Shur-Gard MU Force HT, self-adhered and back-nailed within the selvedge-edge side laps using min. 12 ga. x 3/8" head diameter ring shank nails* through 32 ga., 1-5/8" diameter tin caps spaced 12-inch o.c.	Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed within the selvedge-edge side laps using min. 12 ga. x 3/8" head diameter ring shank nails* through 32 ga., 1-5/8" diameter tin caps spaced 12-inch o.c.	-202.5
UDL-7.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	121 Asphalt Primer at 0.5 gal/sq.	None	None	Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed within the selvedge-edge side laps using min. 12 ga. x 3/8" head diameter ring shank nails* through 32 ga., 1-5/8" diameter tin caps spaced 12-inch o.c.	-255.0
UDL-8.	Structural concrete	121 Asphalt Primer or ASTM D41	None	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-202.5
UDL-9.	Structural concrete	121 Asphalt Primer or ASTM D41	None	None	APP Torch G Premier, torch-applied and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-622.5

5.8.2.2 Mechanically-Attached, Multi-Ply Underlayment Systems:

The maximum design pressure for the selected assembly shall meet or exceed that required under **FRSA/TRI Manual, 7th Edition**, Appendix A or the critical (highest) design pressure determined in accordance with **FBC 1609** or **FBC Residential Chapter 3**. Alternatively, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 design pressure determined in accordance with **FBC 1609** or **FBC Residential Chapter 3**. Elevated pressure zones shall employ an attachment density by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI WD1](#), [FM Loss Prevention Data Sheet 1-29](#) or [Roofing Application Standard RAS 117](#) or RAS 137.

TABLE 4B: ALLOWABLE DESIGN PRESSURES, MECHANICALLY-ATTACHED, MULTI-PLY UNDERLAYMENT SYSTEMS IN TILE ROOF APPLICATIONS						
*Nails shall be corrosion resistant and be of sufficient length to penetrate through the sheathing by min. 3/16-inch						
SYSTEM No.	DECK	BASE SHEET		BASE PLY	CAP PLY	MDP (PSF)
		TYPE	ATTACH			
UDL-10.	Plywood, APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	One (1) layer ASTM D226, Type II felt	Min. 11 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps; 4-inch o.c. at the 2-inch wide side laps and 4-inch o.c. at two (2) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-45.0
UDL-11.	OSB, APA rated sheathing, 24/16, Exposure 1, PS2, 7/16 category	Nail Base	Min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps; 6-inch o.c. at the 3-inch wide side laps and 6-inch o.c. at four (4) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-45.0
UDL-12.	Plywood, APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	Polyglass "Polyanchor HV" (FL5259)	Min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8" diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 12-inch o.c. at two (2) equally spaced center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed in accordance with Mule-Hide installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed using min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-45.0
UDL-13.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	Nail Base	Simplex Original Cap Nails; 6-inch o.c. at the 3-inch wide side laps and 6-inch o.c. at four (4) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-52.5
UDL-14.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	Nail Base	Simplex Original Cap Nails; 6-inch o.c. at the 3-inch wide side laps and 6-inch o.c. at four (4) equally spaced staggered center rows.	None	APP Torch G Premier, torch-applied and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-52.5
UDL-15.	Plywood, APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	Nail Base	Min. 11 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps; 8-inch o.c. at the 4-inch wide side laps and 8-inch o.c. at three (3) equally spaced staggered center rows.	None	APP Torch G Premier, torch-applied and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-60.0

**TABLE 4B: ALLOWABLE DESIGN PRESSURES,  
MECHANICALLY-ATTACHED, MULTI-PLY UNDERLAYMENT SYSTEMS IN TILE ROOF APPLICATIONS**  
\*Nails shall be corrosion resistant and be of sufficient length to penetrate through the sheathing by min. 3/16-inch

SYSTEM No.	DECK	BASE SHEET		BASE PLY	CAP PLY	MDP (PSF)
		TYPE	ATTACH			
UDL-16.	OSB, APA rated sheathing, 40/20, Exposure 1, PS2, 19/32 category	Nail Base	TRUFAST Versa-Fast Fasteners & Plates (FL4500); two (2) screws per plate installed 180° into the holes of the plate, parallel to the width direction of the sheet; 12-inch o.c. at the 4-inch wide side laps and 12-inch o.c. at two (2) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-67.5
UDL-17.	OSB, APA rated sheathing, 40/20, Exposure 1, PS2, 19/32 category	Nail Base	TRUFAST Versa-Fast Fasteners & Plates (FL4500); two (2) screws per plate installed 180° into the holes of the plate, parallel to the width direction of the sheet; 12-inch o.c. at the 4-inch wide side laps and 12-inch o.c. at two (2) equally spaced staggered center rows.	None	APP Torch G Premier, torch-applied and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-67.5
UDL-18.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	Polyglass "Polyanchor HV" (FL5259)	Simplex Original Cap Nails; 6-inch o.c. at the 4-inch wide side laps and 6-inch o.c. at four (4) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed using Simplex Original Cap Nails, max. 12-inch o.c.	-67.5
UDL-19.	Plywood, APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	Tamko "No. 30 UL" (FL12328)	Min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8" diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 6-inch o.c. at three (3) equally spaced center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed using min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-67.5
UDL-20.	Plywood, APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	Polyglass "Polyanchor HV" (FL5259)	Min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps; 10-inch o.c. at the 4-inch wide side laps and 10-inch o.c. at three (3) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed using min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-75.0
UDL-21.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	Polyglass "Polyanchor HV" (FL5259)	Min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps; 6-inch o.c. at the 2-inch wide side laps and 6-inch o.c. at three (3) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed using min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-82.5
UDL-22.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	Nail Base	OMG #12 Standard Roofgrip or OMG #14 Heavy Duty with OMG 3" Round Metal Plates or OMG AccuTrac Flat Bottom Metal Plates (FL699); 6-inch o.c. at the 4-inch wide side laps and 6-inch o.c. at three (3) equally spaced staggered center rows.	None	APP Torch G Premier, torch-applied and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-90.0

**TABLE 4B: ALLOWABLE DESIGN PRESSURES,  
MECHANICALLY-ATTACHED, MULTI-PLY UNDERLAYMENT SYSTEMS IN TILE ROOF APPLICATIONS**

*\*Nails shall be corrosion resistant and be of sufficient length to penetrate through the sheathing by min. 3/16-inch*

SYSTEM No.	DECK	BASE SHEET		BASE PLY	CAP PLY	MDP (PSF)
		TYPE	ATTACH			
UDL-23.	OSB, APA rated sheathing, 24/16, Exposure 1, PS2, 7/16 category	Nail Base	TRUFast Versa-Fast Fasteners & Plates (FL4500); two (2) screws per plate installed 180° into the holes of the plate, parallel to the width direction of the sheet; 9-inch o.c. at the 2-inch wide side laps and 12-inch o.c. at two (2) equally spaced staggered center rows. 121 Asphalt Primer or ASTM D41 primer applied to stress plates.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-90.0
UDL-24.	OSB, APA rated sheathing, 24/16, Exposure 1, PS2, 7/16 category	Nail Base	TRUFast Versa-Fast Fasteners & Plates (FL4500); two (2) screws per plate installed 180° into the holes of the plate, parallel to the width direction of the sheet; 9-inch o.c. at the 2-inch wide side laps and 12-inch o.c. at two (2) equally spaced staggered center rows.	None	APP Torch G Premier, torch-applied and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-90.0
UDL-25.	Plywood, APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	Nail Base	Min. 11 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps; 4-inch o.c. at the 4-inch wide side laps and 4-inch o.c. at four (4) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-97.5
UDL-26.	OSB, APA rated sheathing, 24/16, Exposure 1, PS2, 7/16 category	Nail Base	TRUFast Versa-Fast Fasteners & Plates (FL4500); two (2) screws per plate installed 180° into the holes of the plate, parallel to the width direction of the sheet; 6-inch o.c. at the 4-inch wide side laps and 6-inch o.c. at three (3) equally spaced staggered center rows. 121 Asphalt Primer or ASTM D41 primer applied to stress plates.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-105.0
UDL-27.	OSB, APA rated sheathing, 24/16, Exposure 1, PS2, 7/16 category	Nail Base	TRUFast Versa-Fast Fasteners & Plates (FL4500); two (2) screws per plate installed 180° into the holes of the plate, parallel to the width direction of the sheet; 6-inch o.c. at the 4-inch wide side laps and 6-inch o.c. at three (3) equally spaced staggered center rows	None	APP Torch G Premier, torch-applied and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-105.0
UDL-28.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	Polyglass "Polyanchor HV" (FL5259)	Min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps; 5-inch o.c. at the 4-inch wide side laps and 5-inch o.c. at four (4) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed using min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-105.0
UDL-29.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	Polyglass "Polyanchor HV" (FL5259)	Simplex Original Cap Nails; 4-inch o.c. at the 4-inch wide side laps and 4-inch o.c. at four (4) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed using Simplex Original Cap Nails, max. 12-inch o.c.	-105.0

**TABLE 4B: ALLOWABLE DESIGN PRESSURES,  
MECHANICALLY-ATTACHED, MULTI-PLY UNDERLAYMENT SYSTEMS IN TILE ROOF APPLICATIONS**  
\*Nails shall be corrosion resistant and be of sufficient length to penetrate through the sheathing by min. 3/16-inch

SYSTEM No.	DECK	BASE SHEET		BASE PLY	CAP PLY	MDP (PSF)
		TYPE	ATTACH			
UDL-30.	<b>Plywood</b> , APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	Polyglass "Polyanchor HV" (FL5259)	Min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps; 6-inch o.c. at the 2-inch wide side laps and 6-inch o.c. at three (3) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed using min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-112.5
UDL-31.	<b>Plywood</b> , APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	Polyglass "Polyanchor HV" (FL5259)	Min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps; 5-inch o.c. at the 4-inch wide side laps and 5-inch o.c. at three (3) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed using min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-120.0
UDL-32.	<b>OSB</b> , APA rated sheathing, 40/20, Exposure 1, PS2, 19/32 category	Nail Base	TRUFast Versa-Fast Fasteners & Plates (FL4500); one (1) screws per plate in the center hole; 9-inch o.c. at the 4-inch wide side laps and 9-inch o.c. at four (4) equally spaced staggered center rows. 121 Asphalt Primer or ASTM D41 primer applied to stress plates.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-127.5
UDL-33.	<b>OSB</b> , APA rated sheathing, 40/20, Exposure 1, PS2, 19/32 category	Nail Base	TRUFast Versa-Fast Fasteners & Plates (FL4500); one (1) screws per plate in the center hole; 9-inch o.c. at the 4-inch wide side laps and 9-inch o.c. at four (4) equally spaced staggered center rows.	None	APP Torch G Premier, torch-applied and back-nailed* in accordance with Mule-Hide's installation instructions, max. 12-inch o.c.	-127.5
UDL-34.	<b>Plywood</b> , APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	Polyglass "Polyanchor HV" (FL5259)	Min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 6-inch o.c. at four (4) equally spaced staggered center rows.	(Optional) Shur-Gard MU Force HT, self-adhered and back-nailed* in accordance with Mule-Hide installation instructions, max. 12-inch o.c.	SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard TU Prime HT, Shur-Gard TU Force HT or Shur-Gard MU Force HT, self-adhered and back-nailed using min. 12 ga. x 3/8" head diameter ring shank roofing nails* with 32 ga., 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-135.0

5.9 Exposure Limitations:

TABLE 5: EXPOSURE LIMITATIONS		
UNDERLAYMENT	PREPARED ROOF COVER INSTALLATION TYPE	MAXIMUM EXPOSURE (DAYS)
Nail Base	Mechanically attached	30
Shur-Gard MU Force HT or Shur-Gard TU Prime HT	Any type (per <a href="#">Table 2</a> )	180
Shur-Gard TU Force HT	Any type (per <a href="#">Table 2</a> )	360
APP Torch G Premier, APP Torch G FR Premier, SA-APP Cap Sheet or SA-APP Cap Sheet FR	Adhesive-set tile roof system	180
	Mechanically attached	UNLIMITED

5.10 **Tile Slippage Limitations:** When loading roof tiles on the underlayment, the maximum roof pitch shall be as follows. These pitch limitations can only be exceeded by using battens or loading boards during loading of the roof tiles.

TABLE 6: TILE SLIPPAGE LIMITATIONS			
UNDERLAYMENT	TILE PROFILE	STAGING METHOD	MAXIMUM STAGING PITCH
APP Torch G Premier or APP Torch G FR Premier	Flat or Lugged	6-tile stack (4 over 2)	4:12
SA-APP Cap Sheet or SA-APP Cap Sheet FR	Flat or Lugged	6-tile stack (4 over 2)	4:12
Shur-Gard MU Force HT	Flat or Lugged	Prohibited without battens or loading boards	N/A
Shur-Gard TU Prime HT	Flat	6-tile stack (4 over 2) or 10-tile stack	7:12
	Lugged	6-tile stack (4 over 2)	7:12
	Lugged	10-tile stack	6:12
Shur-Gard TU Force HT	Flat or Lugged	6-tile stack (4 over 2)	7:12
	Flat or Lugged	10-tile stack	6:12

## 6. INSTALLATION:

- 6.1 Mule-Hide Roof Underlayments shall be installed in accordance with Mule-Hide published installation instructions subject to the [Limitations of Use](#) herein and the specifics noted below.
  - 6.1.1 Consult Mule-Hide requirements for back-nailing at pitch of 2:12 or greater.
  - 6.1.2 All fabric-surfaced, aggregate-surfaced and granule-surfaced end-laps shall have a 6-inch wide, uniform layer of 241 Premium Modified Flashing Cement, 421 Mod Bit Adhesive – Trowel Grade, 251 Premium Wet/Dry Elastomeric Flashing Cement or RGA 1 Flashing Cement applied within the end-lap.
  - 6.1.3 All seal-lap seams (selvage laps) must be firmly rolled with a in accordance with Mule-Hide requirements to ensure full contact and adhesion.
- 6.2 Re-fasten any loose decking panels, and check for protruding nail heads. Sweep the substrate thoroughly to remove any dust and debris prior to application, and prime the substrate (if applicable).
- 6.3 Refer to [Section 6.4](#) for underlayments having prescriptive codified minimum attachment or Tables [4A](#) and [4B](#) for underlayment systems having maximum design pressures established in accordance with FBC 1504.2.1.4.
- 6.4 Underlayment Assemblies with Prescriptive Minimum Attachment for use in NON-TILE applications

6.4.1 **Code Reference: 1507.1.1.1 or R905.1.1.1, Option 1:**

Underlayment adhered to deck

DECK DESCRIPTION: Code-minimum wood or structural concrete deck to the satisfaction of the Authority Having Jurisdiction (refer to [Table 3](#) for specific underlayment/substrate combinations)

UNDERLAYMENT: **SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard MU Force HT, Shur-Gard TU Prime HT or Shur-Gard TU Force HT**, self-adhered in accordance with FBC Section 1507.1.1.1(1) or R905.1.1.1(1) and back-nailed in accordance with Mule-Hide requirements.

SURFACING: FBC Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles, subject to the allowable roof covers in [Table 2](#) herein.

6.4.2

**Code Reference: 1507.1.1.1 or R905.1.1.1, Option 2:**  
 Self-adhering strips to deck-joints followed by underlayment attached to deck

DECK DESCRIPTION: Code-minimum wood deck to the satisfaction of the Authority Having Jurisdiction

SECONDARY WATER BARRIER: Min. 4-in wide strips of **SA Base Sheet** over joints of the roof deck prior to installation of subsequent layer(s) in accordance with FBC Section 1507.1.1.1(2) or R905.1.1.1(2). Do not overlap end-joints or T-joints. All end-joints and T-joints shall be butted firmly side by side, flush with each other but not overlapped.

UNDERLAYMENT: **Nail Base** or FBC Approved ASTM D226, Type II felt, in accordance with FBC Table 1507.1.1.1 or Table R905.1.1.1, with a minimum 4-inch side lap and 6-inch end lap, mechanically fastened to deck

FASTENERS: Min. 0.083-inch diameter annular ring or deformed shank nails with metal or plastic caps\* with a nominal cap diameter of not less than 1-inch and minimum thickness as follows.

<u>Cap Type</u>	<u>Minimum thickness</u>
Metal cap	32 ga. sheet material
Power-driven metal cap	0.010-inch
Plastic cap	0.035-inch (outside edge thickness)

The nail shall be of sufficient length to penetrate through the roof sheathing, or not less than 0.75-inch into the roof sheathing.

\*NOTE: Metal caps are required where the ultimate design wind speed,  $V_{ult}$  equals or exceeds 170 mph.

FASTENING: Grid pattern of 12-inches between the overlaps and 6-inch spacing at the overlaps, in accordance with FBC Table 1507.1.1.1 or Tables R905.1.1.1

SURFACING: FBC Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles, wood shakes or wood shingles, subject to the allowable roof covers in [Table 2](#) herein.

6.4.3

**Code Reference: 1507.1.1.1 or R905.1.1.1, Option 3:**  
 Two-layer underlayment mechanically fastened to deck

DECK DESCRIPTION: Code-minimum wood deck to the satisfaction of the Authority Having Jurisdiction

UNDERLAYMENT: Two (2) layers of **Nail Base** in accordance with FBC Table 1507.1.1.1(3) or Table R905.1.1.1(3).

FASTENERS: Min. 0.083-inch diameter annular ring or deformed shank nails with metal or plastic caps\* with a nominal cap diameter of not less than 1-inch and minimum thickness as follows.

<u>Cap Type</u>	<u>Minimum thickness</u>
Metal cap	32 ga. sheet material
Plastic cap	0.035-inch (outside edge thickness)

The nail shall be of sufficient length to penetrate through the roof sheathing, or not less than 0.75-inch into the roof sheathing.

\*NOTE: Metal caps are required where the ultimate design wind speed,  $V_{ult}$  equals or exceeds 170 mph.

FASTENING: Grid pattern of 12-inches between the overlaps and 6-inch spacing at the overlaps, in accordance with FBC Section 1507.1.1.1(3) or Tables R905.1.1.1(3).

SURFACING: FBC Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles, wood shakes or wood shingles, subject to the allowable roof covers in [Table 2](#) herein.

6.4.4

**Code Reference:** 1507.1.1.1 or R905.1.1.1, Option 1 combined with Option 2 or 3:  
Optional self-adhering strips to deck-joints followed by base sheet mechanically fastened to deck followed by underlayment adhered to base sheet

DECK DESCRIPTION:	Code-minimum wood deck to the satisfaction of the Authority Having Jurisdiction								
SECONDARY WATER BARRIER:	(Optional) Min. 4-in wide strips of <b>SA Base Sheet</b> over joints of the roof deck prior to installation of subsequent layer(s) in accordance with FBC Section 1507.1.1.1(2) or R905.1.1.1(2). Do not overlap end-joints or T-joints. All end-joints and T-joints shall be butted firmly side by side, flush with each other but not overlapped.								
BASE SHEET:	One (1) layer of <b>Nail Base or Polyglass “Polyanchor HV” (FL5259)</b> or FBC Approved ASTM D226, Type II felt, in accordance with FBC Table 1507.1.1.1 or Table R905.1.1.1, with a minimum 4-inch side lap and 6-inch end lap, mechanically fastened to deck or Two (2) layers of <b>Nail Base or Polyglass “Polyanchor HV” (FL5259)</b> or FBC Approved ASTM D226, Type II felt in accordance with FBC Table 1507.1.1.1(3) or Table R905.1.1.1(3), mechanically fastened to deck								
FASTENERS:	Min. 0.083-inch diameter annular ring or deformed shank nails with metal or plastic caps* with a nominal cap diameter of not less than 1-inch and minimum thickness as follows. <table border="0" style="margin-left: 20px;"> <tr> <td style="padding-right: 20px;"><b>Cap Type</b></td> <td><b>Minimum thickness</b></td> </tr> <tr> <td>Metal cap</td> <td>32 ga. sheet material</td> </tr> <tr> <td>Power-driven metal cap</td> <td>0.010-inch</td> </tr> <tr> <td>Plastic cap</td> <td>0.035-inch (outside edge thickness)</td> </tr> </table> The nail shall be of sufficient length to penetrate through the roof sheathing, or not less than 0.75-inch into the roof sheathing.	<b>Cap Type</b>	<b>Minimum thickness</b>	Metal cap	32 ga. sheet material	Power-driven metal cap	0.010-inch	Plastic cap	0.035-inch (outside edge thickness)
<b>Cap Type</b>	<b>Minimum thickness</b>								
Metal cap	32 ga. sheet material								
Power-driven metal cap	0.010-inch								
Plastic cap	0.035-inch (outside edge thickness)								
FASTENING:	*NOTE: Metal caps are required where the ultimate design wind speed, $V_{ult}$ equals or exceeds 170 mph. Grid pattern of 12-inches between the overlaps and 6-inch spacing at the overlaps, in accordance with FBC Table 1507.1.1.1 or Tables R905.1.1.1 or FBC Section 1507.1.1.1(3) or Tables R905.1.1.1(3).								
UNDERLAYMENT:	BASE PLY: (Optional) <b>Shur-Gard MU Force HT</b> , self-adhering and back-nailed in accordance with Mule-Hide requirements. CAP PLY: <b>SA-APP Cap Sheet, SA-APP Cap Sheet FR, Shur-Gard MU Force HT, Shur-Gard TU Prime HT or Shur-Gard TU Force HT</b> , self-adhered in accordance with FBC Section 1507.1.1.1(1) or R905.1.1.1(1) and back-nailed in accordance with Mule-Hide requirements.								
SURFACING:	FBC Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles, wood shakes or wood shingles, subject to the allowable roof covers in <a href="#">Table 2</a> herein.								

**7. BUILDING PERMIT REQUIREMENTS:**

As required by the Building Official or Authority Having Jurisdiction to properly evaluate the installation of this product.

**8. MANUFACTURING PLANTS:**

Contact the named QA entity for manufacturing facilities covered by **F.A.C. Rule 61G20-3** QA requirements. Refer to [Section 4](#) herein for products and production locations having met codified material standards.

**9. QUALITY ASSURANCE ENTITY:**

[UL, LLC – QUA9625](#): (360) 817-5512; [bsai.inspections@ul.com](mailto:bsai.inspections@ul.com)

- END OF PEER -