



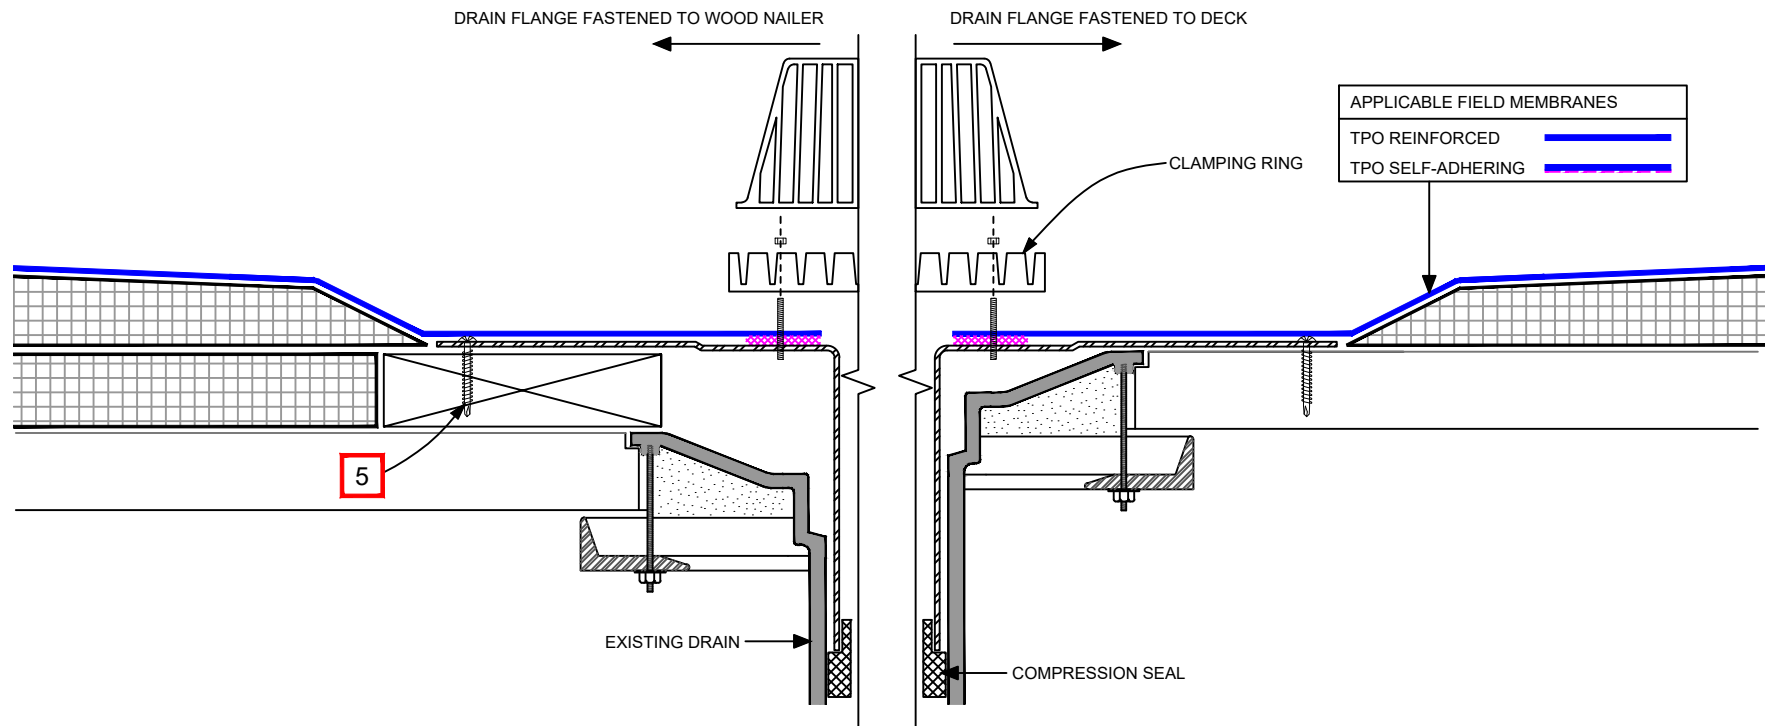

- 1 THE HOLE SHALL BE AT LEAST THE SAME DIAMETER AS THE DRAIN PIPE.
- 2 THE MEMBRANE MUST BE NO LESS THAN 1/2" FROM THE ATTACHMENT POINTS OF THE DRAIN CLAMPING RING
- 3 ALL BOLTS AND CLAMPS MUST BE IN PLACE TO PROVIDE CONSTANT COMPRESSION ON THE WATER CUT-OFF MASTIC
- 4 APPROX. 1/8" BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF TPO REINFORCED MEMBRANE
- 5 SECURE DRAIN FLANGE TO ROOF DECK OR WOOD NAILER WITH A MINIMUM OF 3 FASTENERS EVENLY SPACED AROUND THE FLANGE. EHD OR HDP FASTENERS ARE ACCEPTABLE FOR WOOD, AND STEEL (18 - 22 GA.) SUBSTRATES. HDP ARE ALSO ACCEPTABLE TO CONCRETE. ACCEPTABLE PULLOUT VALUES ARE REQUIRED. REFER TO SPECIFICATIONS FOR OTHER FASTENERS AND SUBSTRATE TYPES.

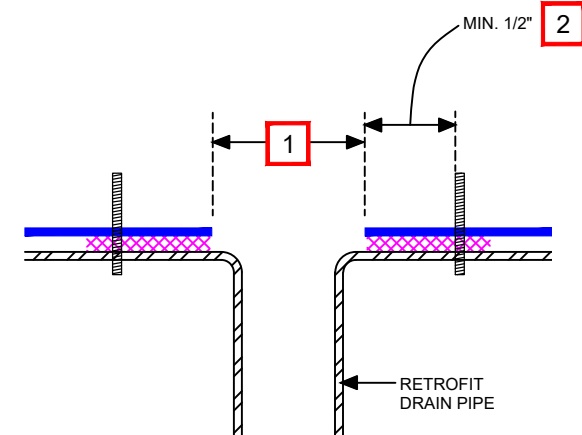

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)
 TPO REINFORCED (ADHERED) (MECHANICALLY ATTACHED) (INDUCTION WELDED)
 TPO SELF- ADHERING (ADHERED)

MULEHIDE

TPO RETROFIT DRAIN FLASHING: SUMP LESS THAN 3":12" SLOPE

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
 ACCEPTABLE FOR : **MAXIMUM 30 YEAR WARRANTY**

DETAIL NO.:
TP-DR-C404

REVISION DATE: 8/24/2026