



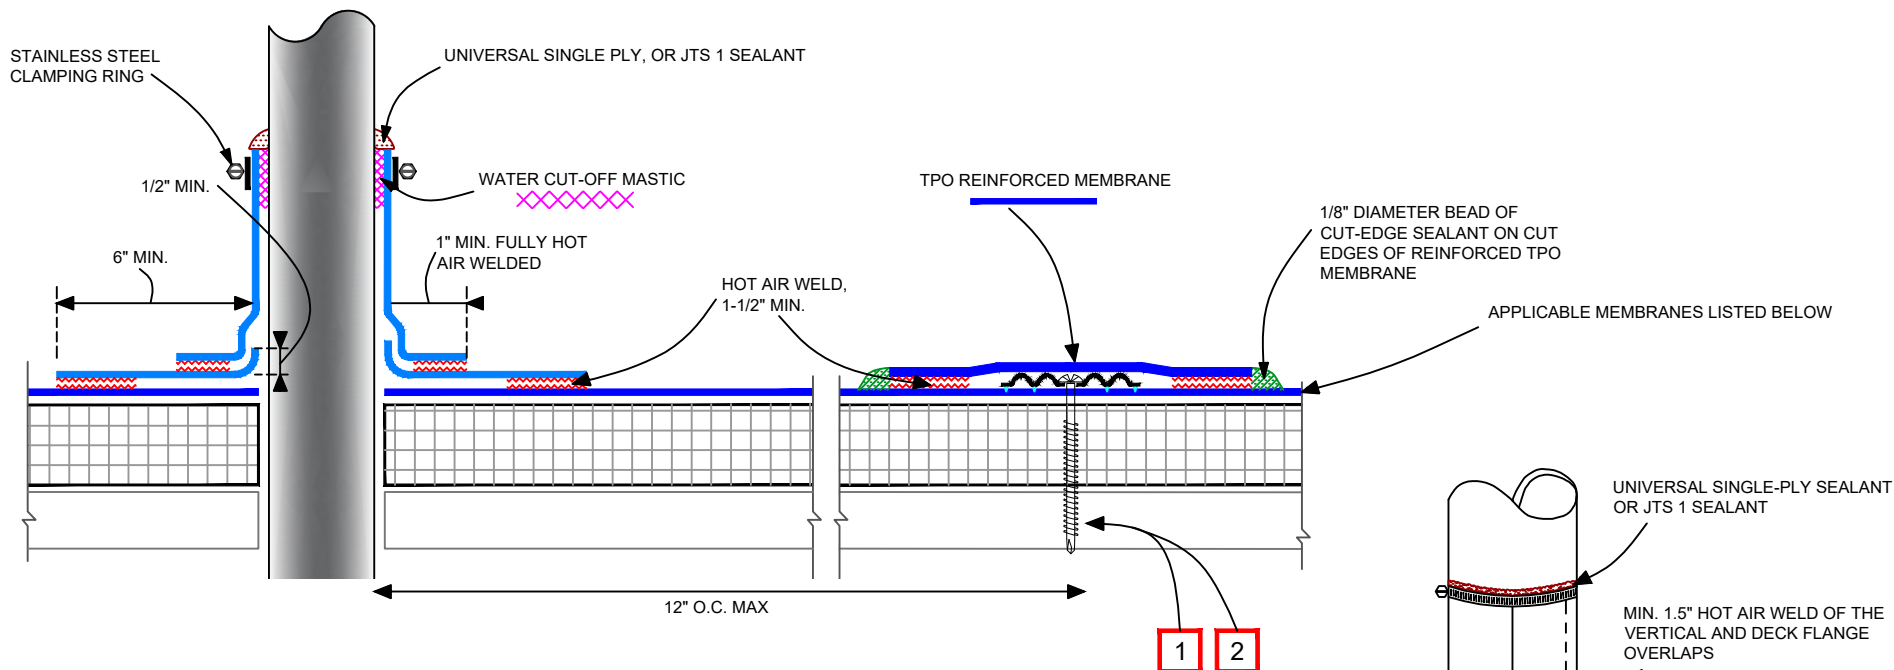

- 1** MULEHIDE APPROVED FASTENERS AND PLATES ARE REQUIRED ON MECHANICALLY ATTACHED AND INDUCTION WELDED SYSTEMS. INSTALL A MINIMUM OF 4 FASTENERS AND PLATES SPACED 12" O.C. MAXIMUM. FOR LARGER PIPE DIAMETERS, ADDITIONAL FASTENERS AND PLATES MAY BE REQUIRED IN ORDER NOT TO EXCEED 12" ON CENTER MAXIMUM SPACING. REFER TO DETAIL **TP-PP-C518**.
- 2** FASTENERS AND PLATES ARE NOT REQUIRED ON ADHERED SYSTEMS UNLESS THE PIPE DIAMETER EXCEEDS 18". REFER TO DETAIL **TP-PP-C518**.
- 3** TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 160° F.
- 4** REMOVE ALL LEAD OR OTHER FLASHING BEFORE INSTALLING THE WHITE OR GRAY EPDM PS UNCURED FLASHING.

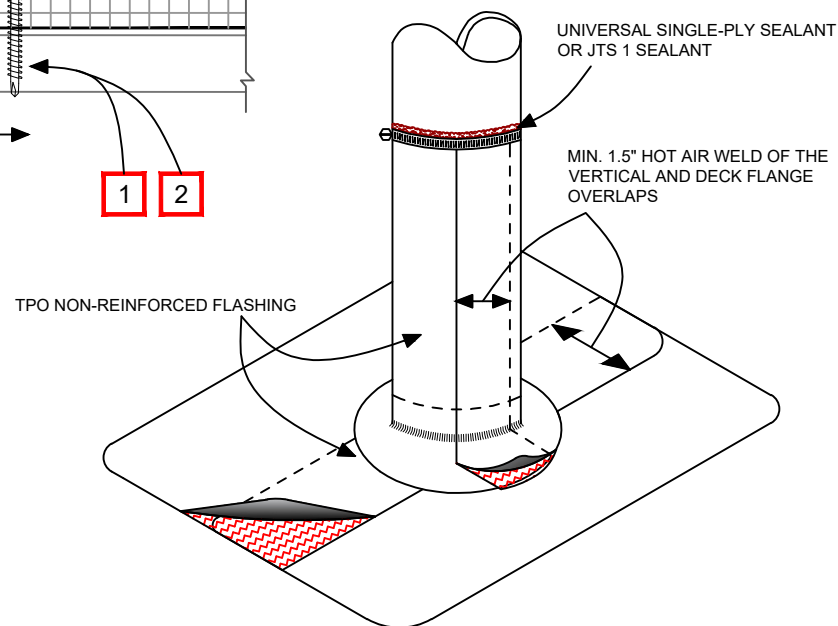

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)
 TPO REINFORCED (ADHERED) (MECHANICALLY ATTACHED) (INDUCTION WELDED)
 TPO FLEECE BACK (ADHERED) (MECHANICALLY ATTACHED)
 TPO SELF-ADHERING (ADHERED)

MULEHIDE

TPO: FIELD WRAPPED PIPE W/ TPO NON-REINFORCED FLASHING

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
 ACCEPTABLE FOR : **MAXIMUM 20 YEAR WARRANTY**

DETAIL NO.:
TP-PP-A504

REVISION DATE: 8/24/2026