



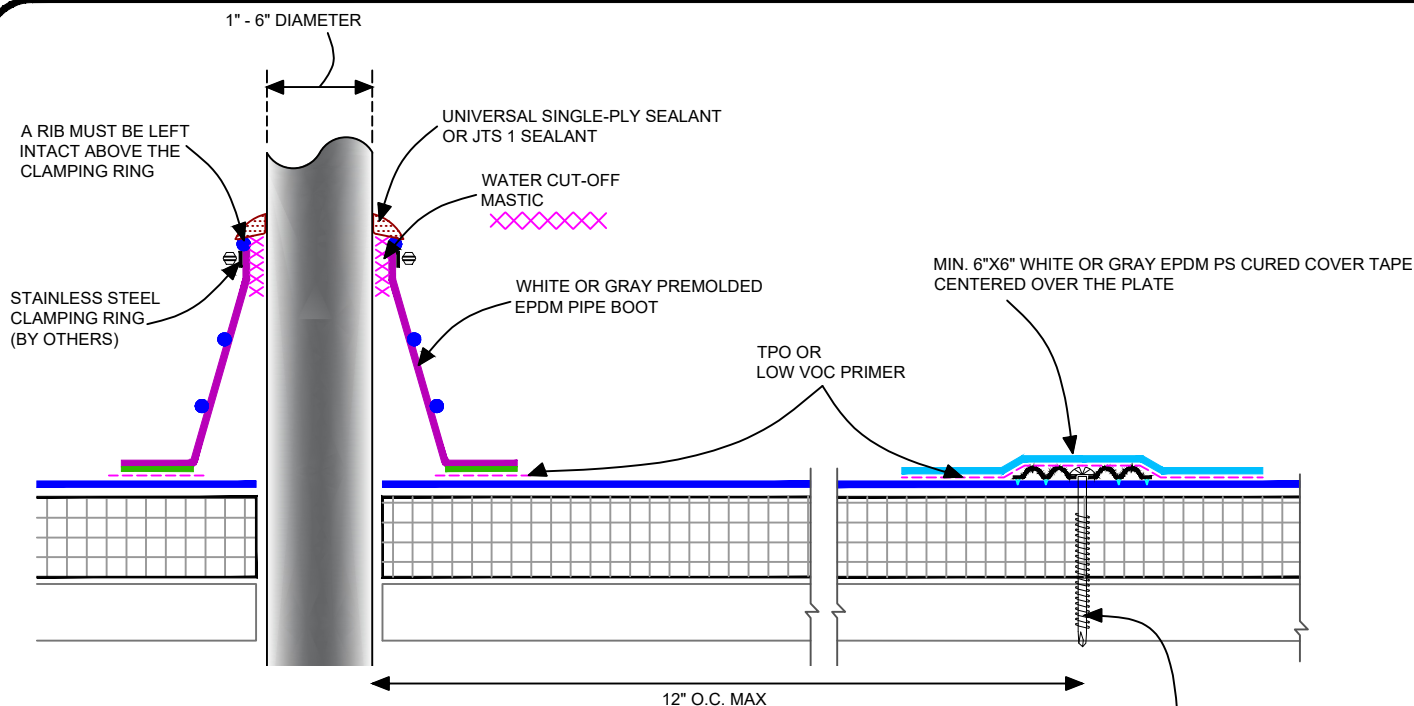

- 1** MULEHIDE APPROVED FASTENERS AND PLATES ARE REQUIRED ON MECHANICALLY ATTACHED AND INDUCTION WELDED SYSTEMS. INSTALL A MINIMUM OF 4 FASTENERS AND PLATES SPACED 12" O.C. MAXIMUM. FOR LARGER PIPE DIAMETERS, ADDITIONAL FASTENERS AND PLATES MAY BE REQUIRED IN ORDER NOT TO EXCEED 12" ON CENTER MAXIMUM SPACING. REFER TO DETAIL **TP-PP-A519**.
- 2** TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 180° F.
- 3** REMOVE ALL LEAD OR OTHER FLASHING BEFORE INSTALLING THE WHITE OR GRAY EPDM PS UNCURED FLASHING.

WHITE OR GRAY UNIVERSAL SINGLE-PLY SEALANT OR JTS 1 SEALANT

T-JOINT PATCHES OF MIN. 6"X6" WHITE OR GRAY EPDM UNCURED FLASHING IN CONJUNCTION W/ TPO OR LOW VOC PRIMER MUST BE CENTERED OVER SEAM INTERSECTIONS OF EPDM PIPE BOOTS AS SHOWN.

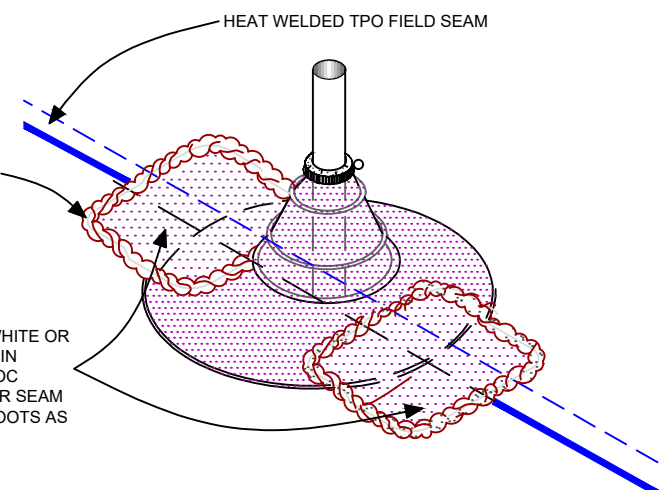

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)
 TPO REINFORCED (ADHERED) (MECHANICALLY ATTACHED) (INDUCTION WELDED)
 TPO FLEECE BACK (ADHERED) (MECHANICALLY ATTACHED)
 TPO SELF-ADHERING (ADHERED)

MULEHIDE

TPO: WHITE OR GRAY EPDM PRESSURE-SENSITIVE PIPE BOOT

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
 ACCEPTABLE FOR : **MAXIMUM 20 YEAR WARRANTY**

DETAIL NO.:
TP-PP-A500

REVISION DATE: 8/24/2026