



REFER TO TERMINATION
OPTIONS A, B, OR C


APPLICABLE FIELD
MEMBRANES LISTED
BELOW

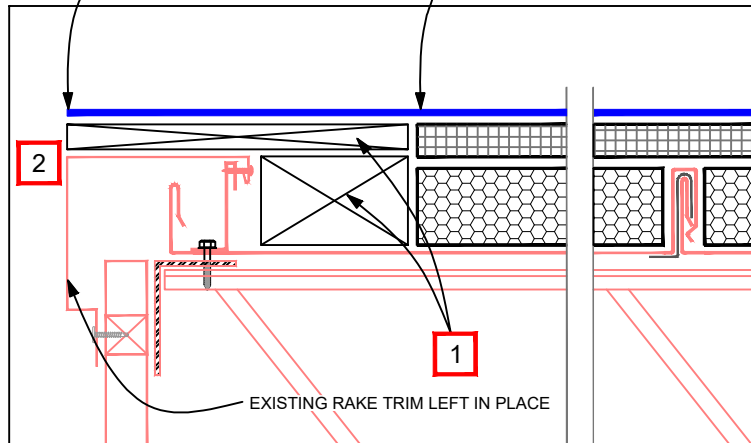


- 1** WOOD NAILERS (BY OTHERS) MUST BE SECURELY FASTENED. FACTORY MUTUAL'S PROPERTY LOSS PREVENTION DATA SHEET 1-49 IS A REFERENCE FOR SECUREMENT CRITERIA.
- 2** TOP WOOD NAILER SHALL BE SUFFICIENT THICKNESS TO PERMIT PROPER ATTACHMENT OF EDGE METAL FASTENERS.
- 3** WHEN FLEECE BACK MEMBRANE IS USED IN OPTION A, THE SELVAGE EDGE MUST BE IN CONTACT W/ THE WATER CUT-OFF MASTIC, OR AN APPROXIMATE 6" WIDE STRIP OF TPO REINFORCED (NON-FLEECE) MEMBRANE MUST BE WELDED AT ROOF EDGE TO BE PLACED IN CONTACT WITH THE WATER CUT-OFF MASTIC. REFER TO DETAIL **TP-TM-C610** OR **TP-TM-C611**
- 4** ENSURE PROPER DRAINAGE IS NOT RESTRICTED WHEN CONSIDERING THE USE OF GRAVEL STOP OR FASCIA EDGE METAL
- 5** MECHANICALLY ATTACHED METAL RETROFIT SYSTEMS W/ FIELD MEMBRANE ATTACHED TO PURLINS ARE APPROVED FOR WARRANTIES UP TO 30 YEARS. REFER TO DETAILS **TP-LO-C1108**, **TP-LO-C1109**, **TP-LO-C1110**. ALL OTHER METAL RETROFIT SYSTEM OPTIONS ARE LIMITED TO 20 YEAR MAX.

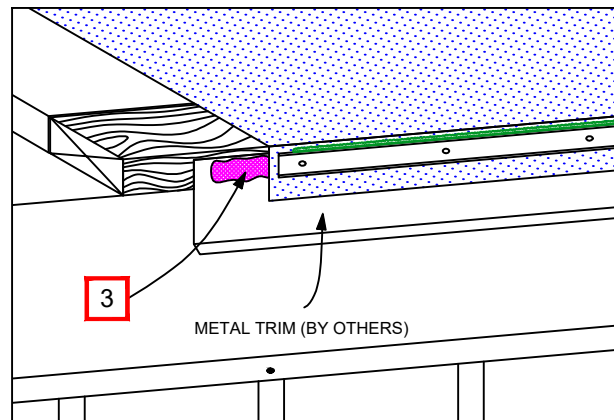

**OPTION A - MULEHIDE AP BAR OR ALUMINUM BAR
W/ 1-3/4" FASCIA COVER COMBINATION**
REFER TO DETAIL **TP-TM-C610** OR **T-TM-C611** FOR
ADDITIONAL REQUIREMENTS

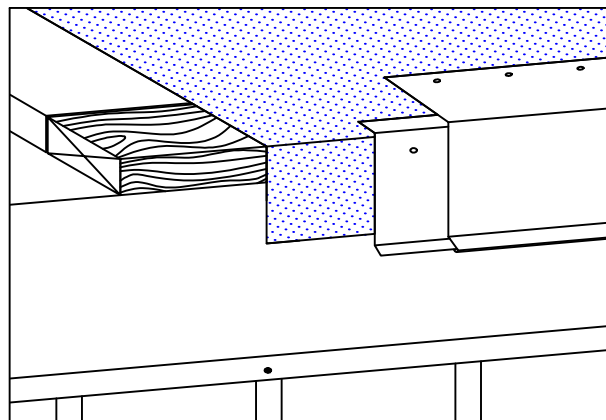

OPTION B - DRIP EDGE OR GRAVEL STOP
REFER TO DRIP EDGE DETAILS FOR OPTIONS, AND
FOR ADDITIONAL INSTALLATION AND FLASHING
REQUIREMENTS

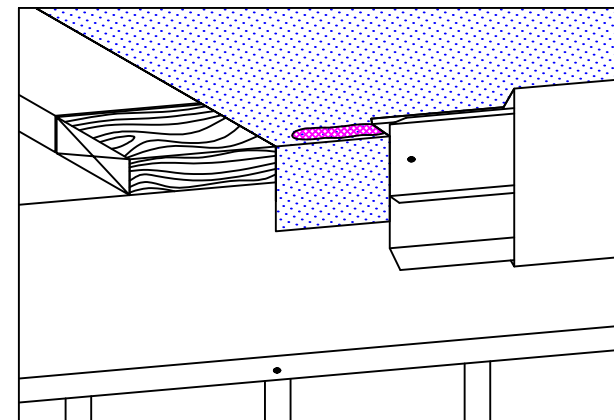

OPTION C - FASCIA EDGE METAL
REFER TO DETAIL **TP-EM-C116** OR **TP-EM-C117** FOR
ADDITIONAL INSTALLATION AND FLASHING
REQUIREMENTS

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)
TPO REINFORCED (ADHERED) (MECHANICALLY ATTACHED)
TPO FLEECE BACK (ADHERED)
TPO SELF-ADHERING (ADHERED)

MULEHIDE

TPO METAL RETROFIT: RAKE CONDITION AND OPTIONS
WHEN RAKE TRIM LEFT IN PLACE

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
ACCEPTABLE FOR : **MAXIMUM 30 YEAR WARRANTY**

DETAIL NO.:
TP-EM-C125

REVISION DATE: 8/24/2026