



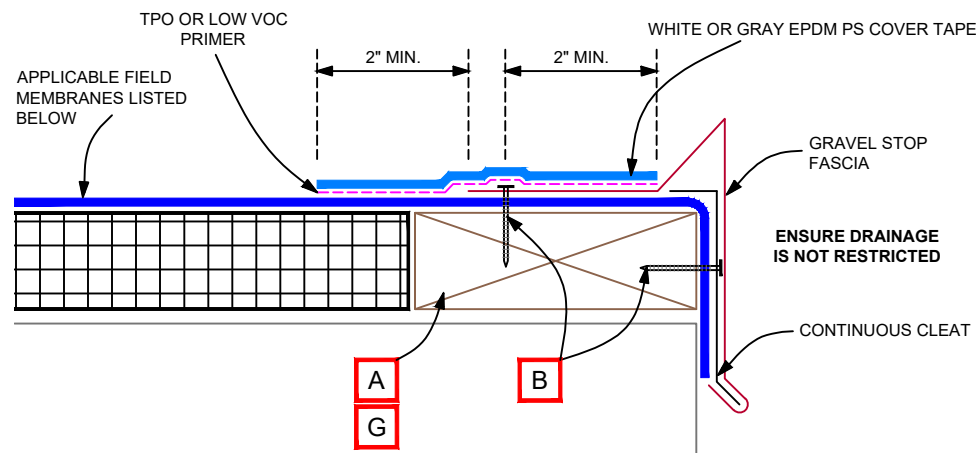


- A** WOOD NAILERS (BY OTHERS) MUST BE SECURELY FASTENED. FACTORY MUTUAL'S PROPERTY LOSS PREVENTION DATA SHEET 1-49 IS A REFERENCE FOR SECUREMENT CRITERIA.
- B** 1-1/4" RING SHANK NAILS FOR WOOD SUBSTRATE. CONTINUOUS CLEAT MUST BE FASTENED 12" O.C. AND ADJOINING SECTIONS OF CONTINUOUS CLEAT SHALL BE LAPPED 1". THE DRIP EDGE FASCIA FLANGE MUST BE FASTENED 6" O.C. INTO THE PRE-PUNCHED HOLES WITH NO BUCKLING OR BOWING OF THE FLANGE.
- C** SPLICE PLATES ARE PROVIDED/INCLUDED WITH MULEHIDE KYNAR GRAVEL STOP METAL. WHEN SPLICE PLATES ARE NOT INCLUDED WITH METAL BY OTHERS, FASCIA METAL MUST BE SUFFICIENTLY OVERLAPPED AND SEALED TO PREVENT MOISTURE FROM ENTERING THE ROOF SYSTEM.
- D** AT T-JOINT INTERSECTIONS, APPLY T-PATCHES OF WHITE OR GRAY EPDM PS UNCURED FLASHING CENTERED OVER THE INTERSECTIONS. APPLY AND FEATHER UNIVERSAL SINGLE-PLY SEALANT OR JTS 1 SEALANT TO THE EDGES OF THE FLASHING.
- E** WHEN USING TPO FLEECE BACK OR SELF-ADHERING MEMBRANE, END LAP SEAMS MUST BE OVERLAID WITH MIN. 6" WIDE TPO REINFORCED MEMBRANE. REFER TO DETAILS **TP-SM-C904**, **TP-SM-C905**, **TP-SM-C906**
- F** AT FASCIA JOINTS: APPLY AND FEATHER UNIVERSAL SINGLE-PLY OR JTS 1 SEALANT TO THE JOINT ON THE ROOF FACING SIDE AND 3" MIN. PAST THE TPO PS COVER STRIP INTERSECTION AS SHOWN.
- G** SUPPLEMENTAL WOOD NAILER CONDITIONS OCCUR ON METAL RETROFITS: REFER TO APPLICABLE DETAILS **TP-EM-C121**, **TP-EM-C122**, **TP-EM-C125**, OR **TP-EM-C126**


1

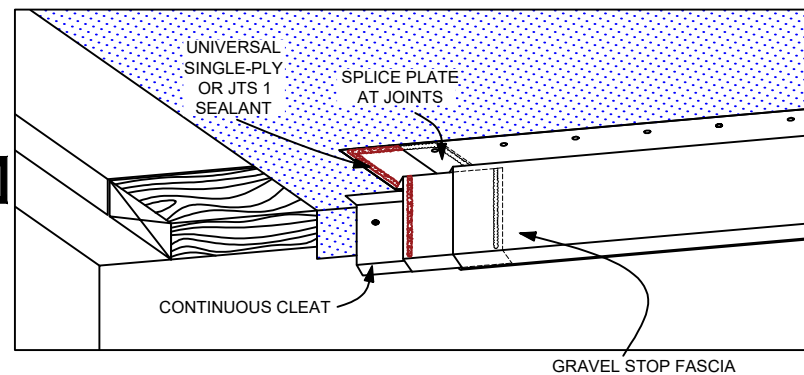

2

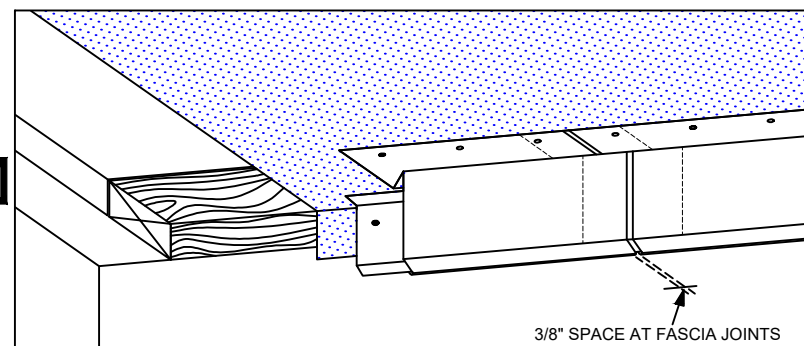

3

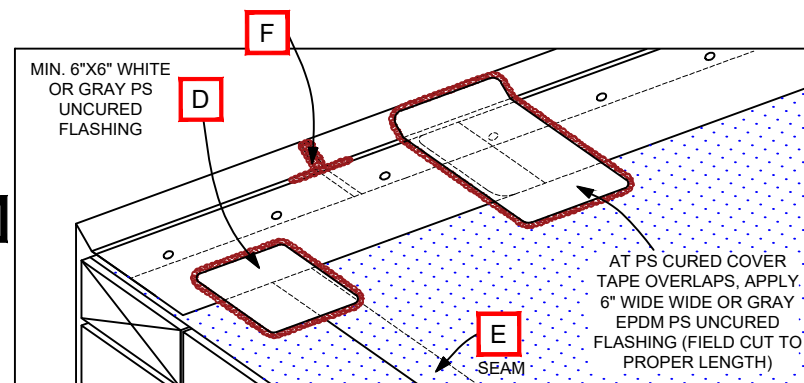

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)
 TPO REINFORCED (ADHERED) (MECHANICALLY ATTACHED) (INDUCTION WELDED)
 TPO FLEECE BACK (ADHERED) (MECHANICALLY ATTACHED)
 TPO SELF-ADHERING (ADHERED)

MULEHIDE

TPO : MULEHIDE KYNAR GRAVEL STOP FLASHED W/
 WHITE OR GRAY EPDM PS CURED COVER TAPE

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
 ACCEPTABLE FOR : **MAXIMUM 20 YEAR WARRANTY**

DETAIL NO.:
TP-EM-A110

REVISION DATE: 8/24/2026