



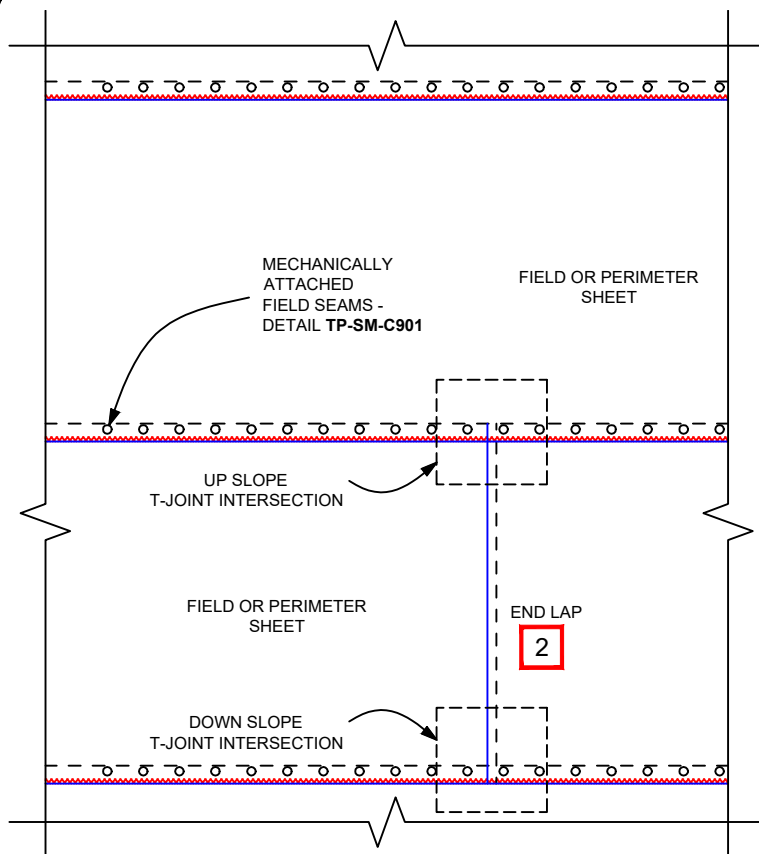


**UP SLOPE T-JOINT:
ADJOINING SHEET
OVERLAPPING END LAP**

ON CUT-EDGES OF REINFORCED
TPO MEMBRANE, APPLY A 1/8"
BEAD OF CUT-EDGE SEALANT

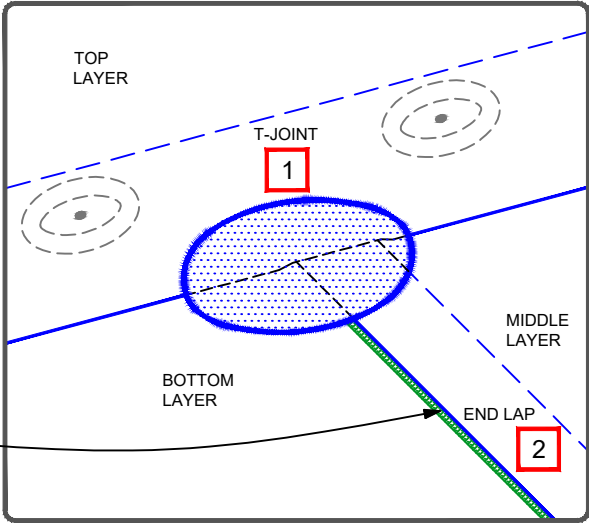

**DOWN SLOPE T-JOINT:
END LAP SEAM OVERLAPPING
ADJOINING SHEET**

ON CUT-EDGES OF REINFORCED
TPO MEMBRANE, APPLY A 1/8"
BEAD OF CUT-EDGE SEALANT

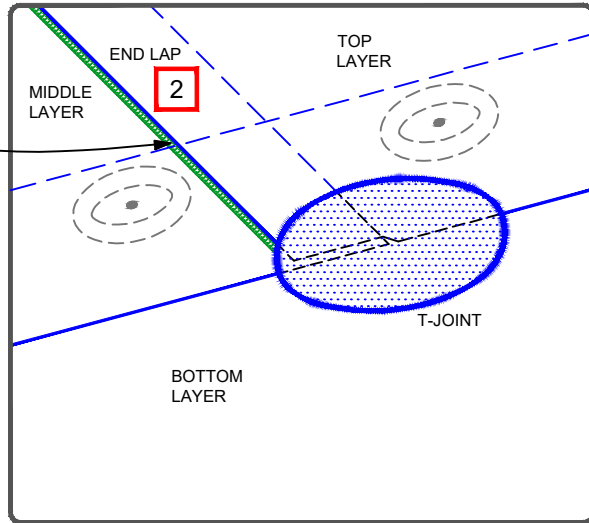

1 AT T-JOINT INTERSECTIONS OF 60-MIL OR THICKER TPO REINFORCED MEMBRANES, INSTALL A T-JOINT PATCH CENTERED OVER THE INTERSECTION

WARRANTY LENGTH	T-JOINT PATCH MATERIAL
20 YEAR	TPO FIELD CUT NON-REINFORCED FLASHING - APPROX 6"X6" W/ ROUNDED CORNERS
25/30 YEAR	PRE-FORMED T-JOINT PATCH

2 FASTENERS AND PLATES ARE NOT REQUIRED IN END LAPS.

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)
TPO REINFORCED (MECHANICALLY ATTACHED)

MULEHIDE

TPO T-JOINT INTERSECTION: MECHANICALLY ATTACHED

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
ACCEPTABLE FOR : **MAXIMUM 30 YEAR WARRANTY**

DETAIL NO.:
TP-SM-C903

REVISION DATE: 8/24/2026