
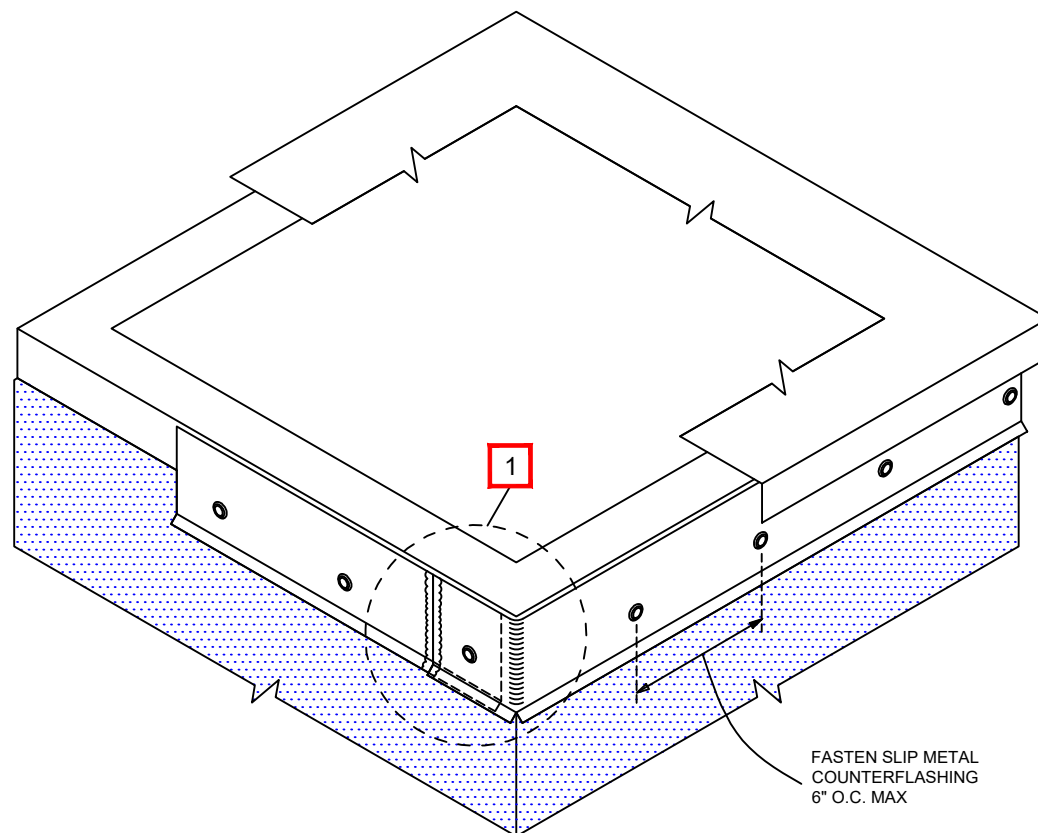


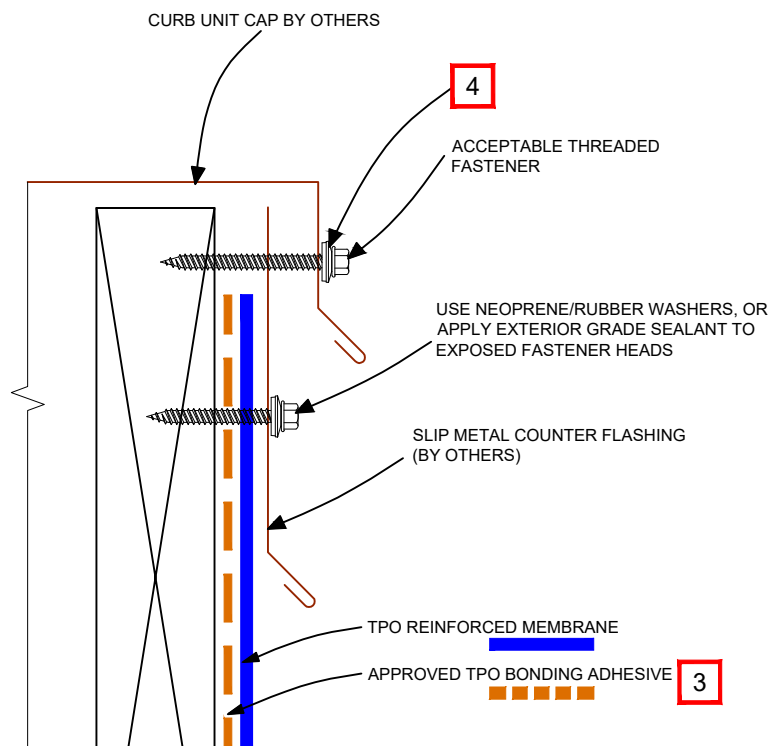

- 1 THERE SHALL BE NO GAPS PRESENT IN THE SLIP METAL COUNTER FLASHING. ADDITIONALLY, ANY ADJOINING SECTIONS OF SLIP METAL COUNTER FLASHING MUST BE OVERLAPPED, WITH SEALANT APPLIED TO OVERLAPS.
- 2 WALL FLASHING HEIGHT MUST BE A MINIMUM OF 8" HIGH WHEN POSSIBLE
- 3 BONDING ADHESIVE IS NOT REQUIRED IF THE WALL FLASHING HEIGHT IS 12" OR LESS
- 4 WHEN CURB UNIT CAP (BY OTHERS) IS FASTENED THROUGH VERTICAL FLANGE AS SHOWN, APPLY EXTERIOR GRADE SEALANT TO THE FASTENER HEADS IF NEOPRENE/RUBBER WASHER WERE NOT USED

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)
 TPO REINFORCED (ADHERED) (MECHANICALLY ATTACHED) (INDUCTION WELDED)
 TPO FLEECE BACK (ADHERED) (MECHANICALLY ATTACHED: 20 YR MAX)
 TPO SELF-ADHERING (ADHERED)

MULEHIDE

TPO CURB TERMINATION W/ SLIP METAL COUNTER FLASHING

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
 ACCEPTABLE FOR : **MAXIMUM 30 YEAR WARRANTY**

DETAIL NO.:
TP-TM-C600

REVISION DATE: 8/24/2026