



NEWLY INSTALLED EXTERIOR FINISHED SIDING MATERIAL (BY OTHERS)

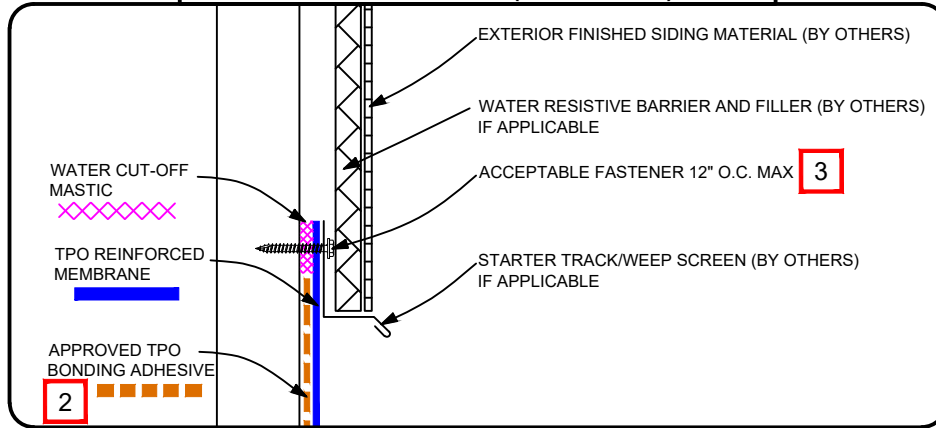

EXISTING SIDING MATERIAL (BY OTHERS) LEFT IN PLACE

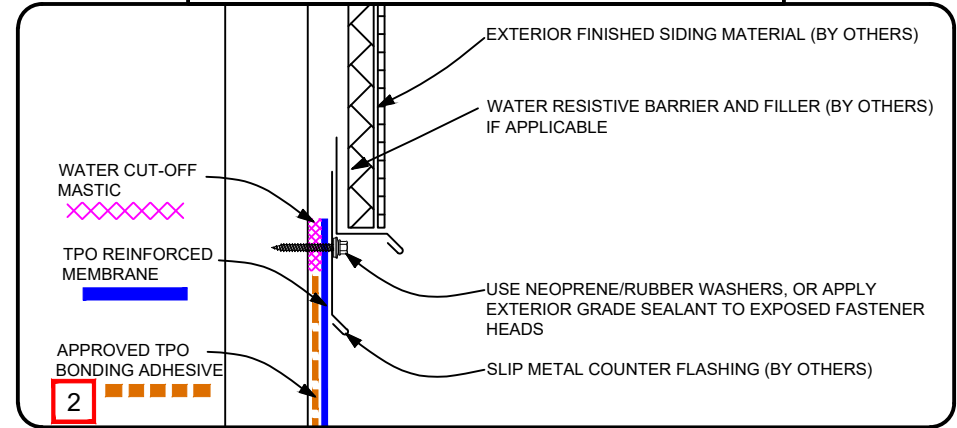

- 1** WALL FLASHING HEIGHT MUST BE A MINIMUM OF 8" HIGH WHEN POSSIBLE
- 2** BONDING ADHESIVE IS NOT REQUIRED IF THE WALL FLASHING HEIGHT IS 12" OR LESS
- 3** IF FASTENERS ARE EXPOSED ON THE OUTER SIDE OF THE EXTERIOR FINISHED SIDING MATERIAL, THEN USE NEOPRENE/RUBBER WASHERS, OR APPLY AN EXTERIOR GRADE SEALANT TO THE FASTENER HEADS
- 4** WHEN THE SUBSTRATE IS CONCRETE, SMOOTH BRICK, OR BLOCK MASONRY, THEN NAIL-DRIVE MASONRY FASTENERS W/ CARBON STEEL DRIVE NAILS ARE APPROVED

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)

TPO REINFORCED (ADHERED) (MECHANICALLY ATTACHED) (INDUCTION WELDED)
TPO FLEECE BACK (ADHERED) (MECHANICALLY ATTACHED: 20 YR MAX)
TPO SELF-ADHERING (ADHERED)

MULEHIDE

TPO WALL TERMINATION: MEMBRANE BEHIND SIDING
MATERIAL (BY OTHERS)

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
ACCEPTABLE FOR : **MAXIMUM 30 YEAR WARRANTY**

DETAIL NO.:
TP-TM-C606

REVISION DATE: 8/24/2026