


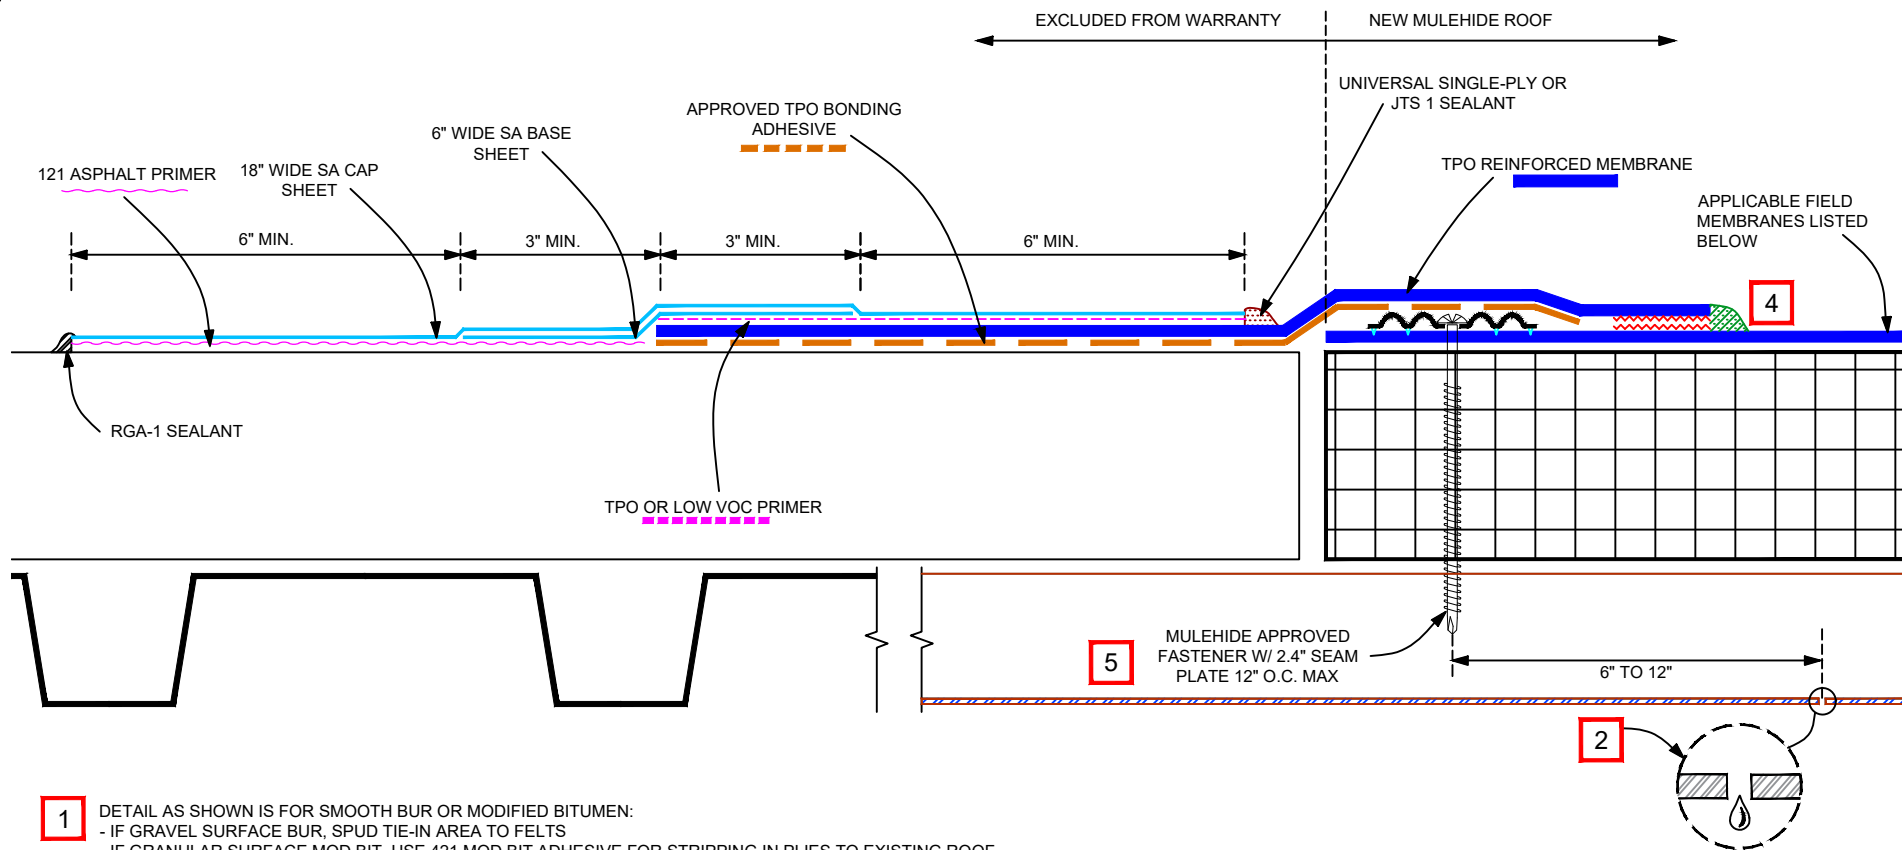

- 1** DETAIL AS SHOWN IS FOR SMOOTH BUR OR MODIFIED BITUMEN:
 - IF GRAVEL SURFACE BUR, SPUD TIE-IN AREA TO FELTS
 - IF GRANULAR SURFACE MOD BIT, USE 421 MOD BIT ADHESIVE FOR STRIPPING IN PLIES TO EXISTING ROOF
- 2** IF THE EXISTING ROOF IS SLOPING TOWARD THE NEW MULEHIDE ROOF SYSTEM AND STEEL DECK FLUTES ARE PERPENDICULAR TO THE TIE-IN, THEN 3/8" DIAMETER WEEP HOLES SHALL BE DRILLED INTO THE BOTTOM FLUTES WITHIN 6" MINIMUM TO 12" MAXIMUM FROM THE EXISTING ROOF SYSTEM. REFER TO DETAIL **TP-TE-C304**.
- 3** DETAIL FOR USE IN RECOVER APPLICATIONS WHEN A COMPLETE TEAR OFF IS NOT REQUIRED TO PREVENT WATER INTRUSION INTO THE MULEHIDE SYSTEM FROM AN EXISTING OR ADJACENT ROOF. REFER TO MULEHIDE SPECIFICATIONS FOR MORE INFORMATION.
- 4** APPROX. 1/8" BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF TPO REINFORCED MEMBRANE
- 5** ON MECHANICALLY ATTACHED SYSTEMS - FASTENER SPACING MUST NOT EXCEED THE SPACING SPECIFIED FOR MEMBRANE ATTACHMENT, WHICH MAY BE CLOSER THAN 12" O.C. BASED ON THE PROJECT WARRANTY REQUIREMENTS. REFER TO SPECIFICATIONS.

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)
 TPO REINFORCED (ADHERED) (MECHANICALLY ATTACHED) (INDUCTION WELDED)
 TPO FLEECE BACK (ADHERED) (MECHANICALLY ATTACHED: 20 YR MAX)
 TPO SELF-ADHERING (ADHERED)

MULEHIDE

TPO : COLD TIE-IN TO BUR / MOD BIT OVER STEEL DECK

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
ACCEPTABLE FOR : **MAXIMUM 30 YEAR WARRANTY**

DETAIL NO.:
TP-TE-C307

REVISION DATE: 8/24/2026