


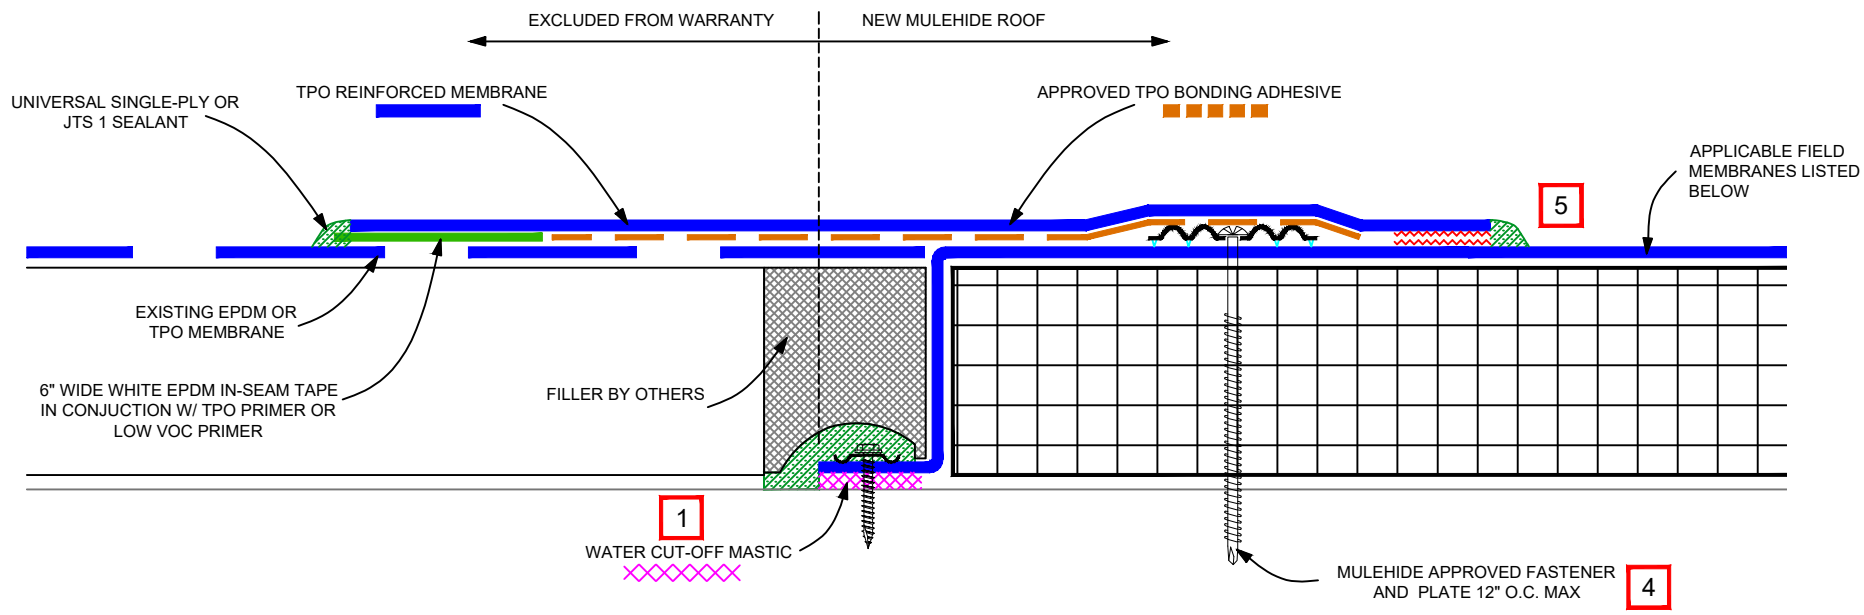

- 1** WATER CUT-OFF MASTIC WITH ALL PURPOSE BAR FASTENED 6" O.C. MAX ARE REQUIRED AT THE TIE IN. ENSURE "BUMPS" OF ALL PURPOSE BAR ARE FACING THE SUBSTRATE. APPROPRIATE FASTENERS ARE REQUIRED. UNIVERSAL SINGLE-PLY SEALANT, OR JTS 1 SEALANT SHALL BE APPLIED OVER THE EXPOSED AREA OF THE ALL PURPOSE BAR AS SHOWN.
- 2** IF EXISTING ROOF IS EPDM MEMBRANE, USE LOW VOC PRIMER.
- 3** FOR EXISTING BALLASTED SYSTEMS, CONSULT THE RESPECTIVE MANUFACTURER FOR ACCEPTABLE BALLAST CONTAINMENT TO PREVENT MIGRATION OF BALLAST ONTO MULEHIDE'S ROOF SYSTEM.
- 4** ON MECHANICALLY ATTACHED SYSTEMS - FASTENER SPACING MUST NOT EXCEED THE SPACING SPECIFIED FOR MEMBRANE ATTACHMENT, WHICH MAY BE CLOSER THAN 12" O.C. BASED ON THE PROJECT WARRANTY REQUIREMENTS. REFER TO SPECIFICATIONS.
- 5** APPROX. 1/8" BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF TPO REINFORCED MEMBRANE
- 6** DETAIL FOR USE IN RECOVER APPLICATIONS WHEN A COMPLETE TEAR OFF IS NOT REQUIRED TO PREVENT WATER INTRUSION INTO THE MULEHIDE SYSTEM FROM AN EXISTING OR ADJACENT ROOF. REFER TO MULEHIDE SPECIFICATIONS FOR MORE INFORMATION.
- 7** WHEN FLEECE BACK MEMBRANE IS USED, THE SELVEDGE (NON-FLEECE EDGE) MUST BE IN CONTACT WITH THE WATER CUT-OFF MASTIC. OTHERWISE, WELD A SECTION OF TPO REINFORCED MEMBRANE ALONG THE EDGE OF THE TIE-IN.

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)
 TPO REINFORCED (ADHERED) (MECHANICALLY ATTACHED) (INDUCTION WELDED)
7 TPO FLEECE BACK (ADHERED) (MECHANICALLY ATTACHED: 20 YR MAX)
 TPO SELF-ADHERING (ADHERED)

MULEHIDE

TPO : TIE-IN TO TPO OR EPDM OVER SOLID DECK

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
 ACCEPTABLE FOR : **MAXIMUM 30 YEAR WARRANTY**

DETAIL NO.:
TP-TE-C311

REVISION DATE: 8/24/2026