


FIGURE C
INDUCTION WELD PLATES FOR CURB OR WALL FLASHING ATTACHMENT

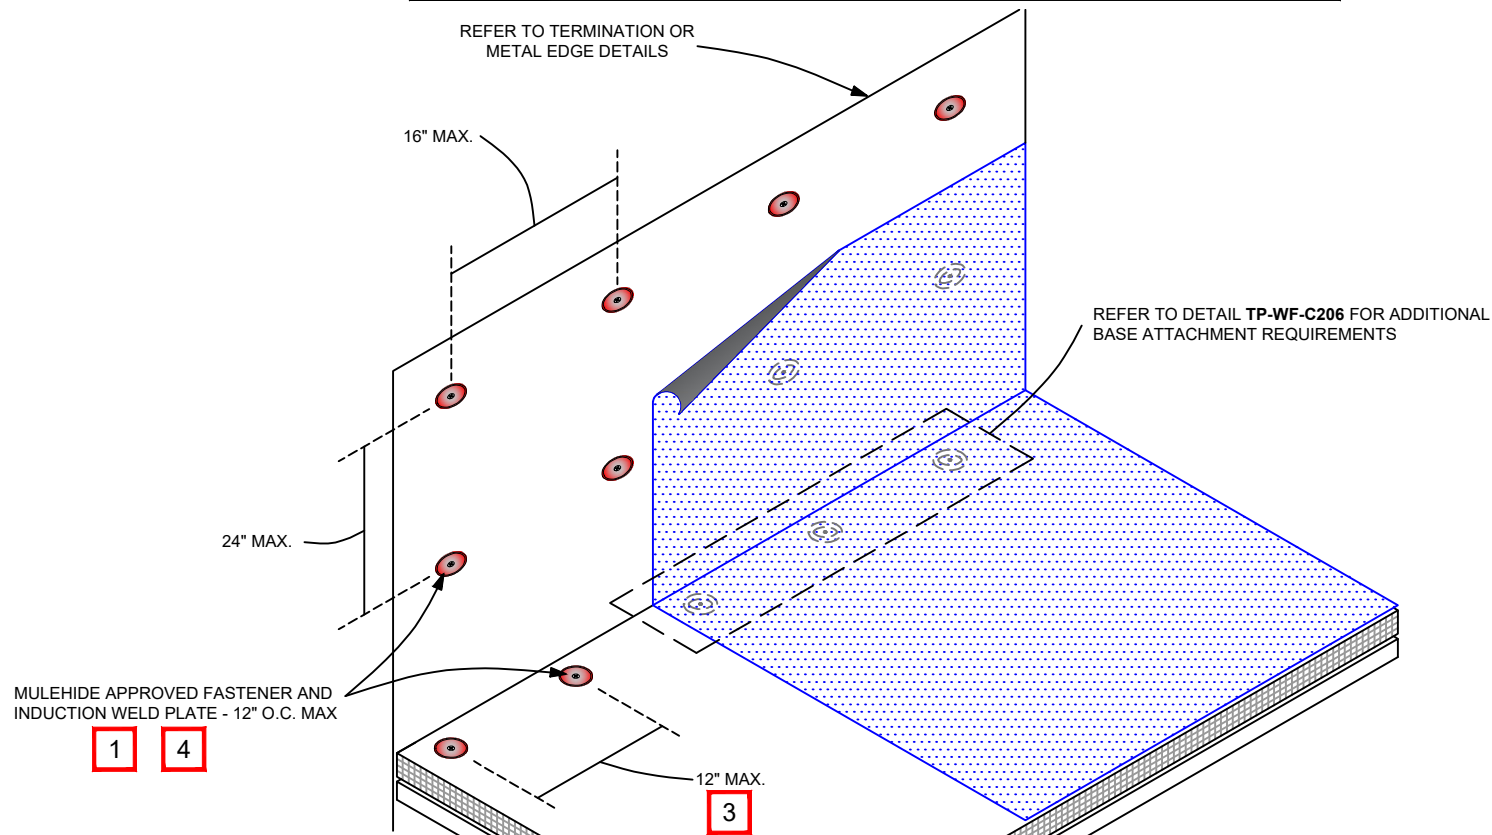

- 1** FASTENERS MUST PENETRATE INTO WOOD OR METAL STUDS, WHERE WALL IS BUILT WITH STUDS.
- 2** INDUCTION WELD CARDBOARD DISKS ARE REQUIRED UNDER INDUCTION WELD PLATES WHEN USING NON-FACED EPS (EXPANDED POLYSTYRENE) OR XPS (XTRUDED POLYSTYRENE) INSULATIONS.
- 3** NOTE THE FOLLOWING WHEN DETAIL EXISTS AT A PERIMETER PARAPET WALL:
 - FASTENER SPACING FOR BASE ATTACHMENT IS REQUIRED AT 6" O.C. WITH A WARRANTY EXCEEDING 90 MPH WIND SPEED COVERAGE OR FOR WARRANTIES GREATER THAN 20 YEARS.
- 4** EHD FASTENERS WITH INDUCTION WELD PLATES ARE APPROVED FOR WOOD AND STEEL (18 - 22 GA.) SUBSTRATES. REFER TO SPECIFICATIONS FOR ACCEPTABLE PULLOUT VALUES, OR FOR OTHER FASTENERS AND COMPATIBLE SUBSTRATES.

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)
TPO REINFORCED (INDUCTION WELDED)

MULEHIDE

TPO IW PLATES FOR WALL ATTACHMENT

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS
ACCEPTABLE FOR : **MAXIMUM 30 YEAR WARRANTY**

DETAIL NO.:
TP-WF-C207

REVISION DATE: 8/24/2026