
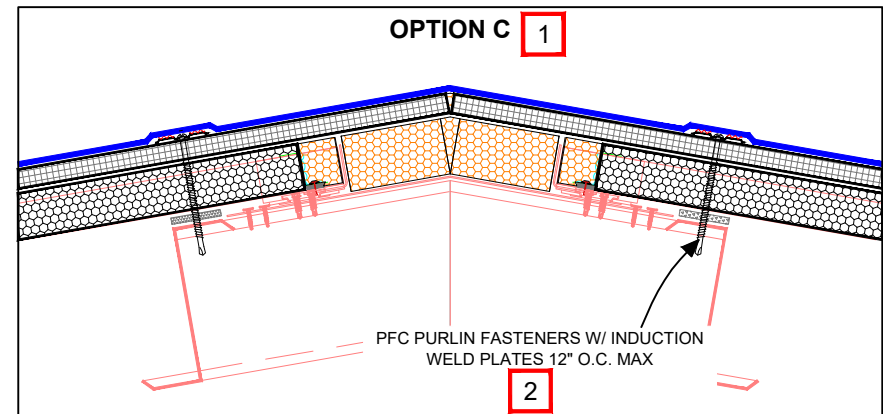
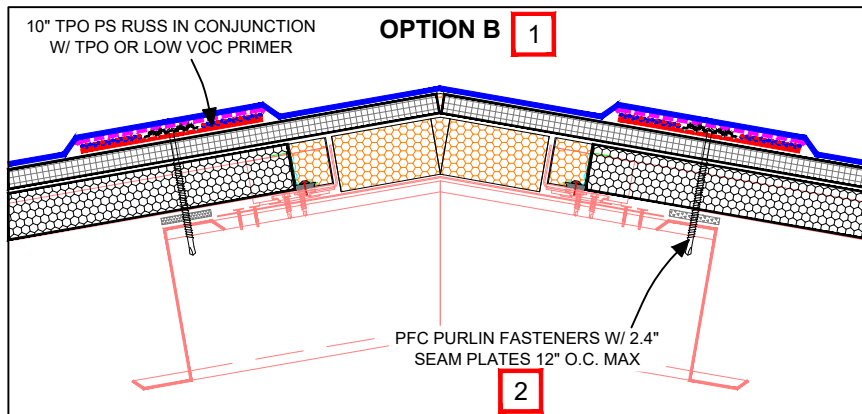
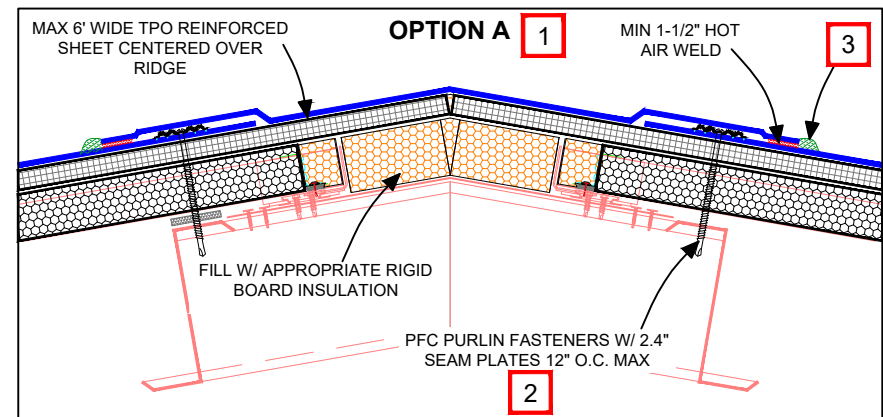


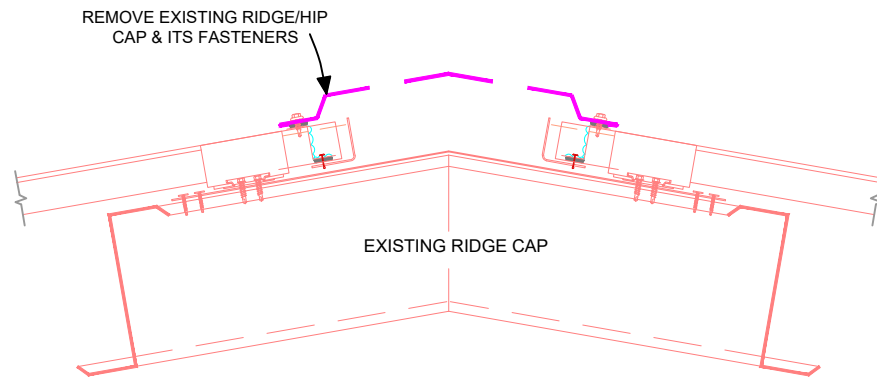

1 MECHANICAL ATTACHMENT MUST BE ACHIEVED ALONG THE FIRST PURLIN ON EACH SIDE OF THE RIDGE AS SHOWN IN EACH OPTION

2 CERTAIN PROJECT WARRANTES REQUIRE FASTENING BE CLOSER THAN 12" O.C. MAX. REFER TO SPECIFICATIONS

3 APPROX. 1/8" BEAD OF CUT-EDGE SEALANT IS REQUIRED ON CUT EDGES OF TPO REINFORCED MEMBRANE

APPLICABLE FIELD MEMBRANE (AND SYSTEMS)  
TPO REINFORCED (MECHANICALLY ATTACHED)

**MULEHIDE**

TPO NON-VENTED RIDGE ATTACHMENT: MA METAL RETROFIT  
PURLIN ATTACHMENT

WHEN THE SYSTEM TYPE AND PROJECT DESIGN PERMIT, THIS DETAIL IS  
ACCEPTABLE FOR : **MAXIMUM 30 YEAR WARRANTY**

**DETAIL NO.:**  
**TP-MS-C805**

REVISION DATE: 8/24/2026