

NOTES:


1. DETAILS TO BE USED IN CONJUNCTION WITH STANDARD GUIDE SPECIFICATIONS CONTAINING REQUIREMENTS FOR NAILERS, INSULATION, SLIPSHEETS, ETC.
2. ACCORDING TO PROJECT CONDITIONS, THE SPECIFIER AND/OR APPLICATOR MUST IDENTIFY THE WIDTH DIMENSIONS OF THE ROOF PERIMETERS AND CORNERS IN ACCORDANCE WITH FM DATA SHEETS 1-28 AND 1-29 BASED UPON THE FOLLOWING FORMULA:

- 0.4 TIMES THE BUILDING HEIGHT OR
- 0.1 TIMES THE BUILDING'S LESSER PLAN DIMENSION, WHICHEVER IS SMALLER

THE MINIMUM PERIMETER/CORNER WIDTH SHALL BE NO LESS THAN 3 FEET

3. FOR STEEL DECKS:
 - ALL FASTENERS MUST ENGAGE TOP FLUTES OF DECK
 - IN THE FIELD OF THE ROOF, SEAMS (FASTENER ROWS) MUST RUN PERPENDICULAR TO THE DECK FLUTES
 - PERIMETER HALF SHEETS ARE TO BE USED ONLY ON SIDES OF ROOF WHEN THE SEAMS RUN PERPENDICULAR TO THE DECK FLUTES
4. 10" WIDE TPO PRESSURE-SENSITIVE RUSS CAN BE USED BENEATH FIELD SHEETS IN LIEU OF FASTENERS AND PLATES INSTALLED THROUGH THE MEMBRANE OR PERIMETER HALF SHEETS.
5. USE ADDITIONAL HALF SHEETS INSTALLED WITH SEAMS RUNNING PERPENDICULAR TO THE DECK FLUTES TO MEET OR SLIGHTLY EXCEED FM PERIMETER DIMENSION REQUIREMENTS AS OUTLINED IN NOTE 2 ABOVE. EXAMPLE: A 14' PERIMETER DIMENSION WOULD REQUIRE FOUR 4' PERIMETER SHEETS (14' DIVIDED BY 3'6" COVERAGE PROVIDED BY A 4' WIDE SHEET)

REFER TO MULE-HIDE TECHNICAL BULLETIN #TPO-MA02-2006 FOR PERIMETER ENHANCEMENT REQUIREMENTS

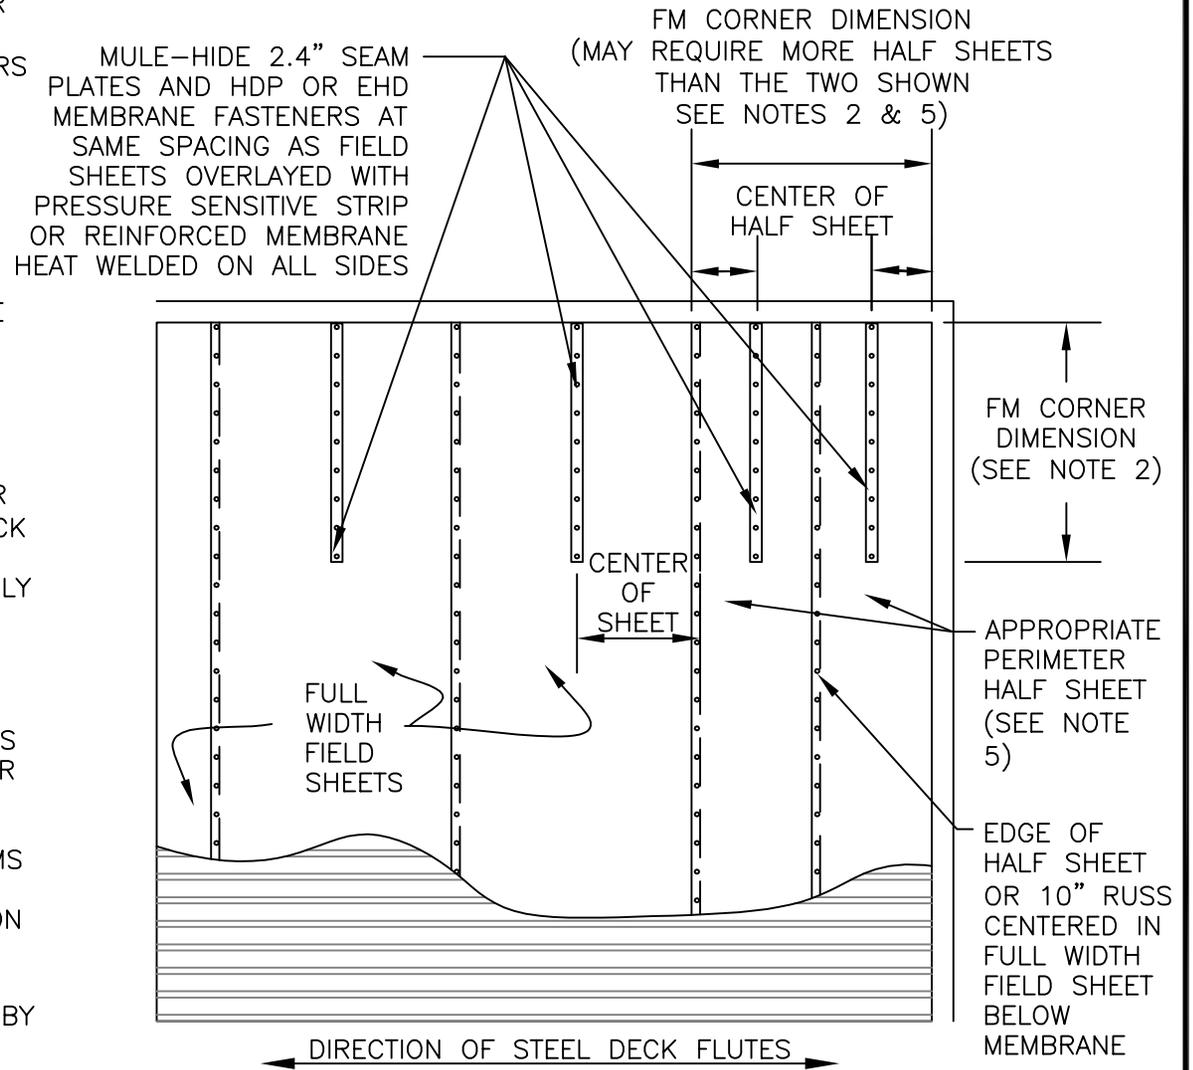

**MULE-HIDE
PRODUCTS CO., INC.**

**FM CORNER / PERIMETER
FASTENING ENHANCEMENTS - OPTION A
SYSTEMS:**

TPO MECHANICALLY ATTACHED

DETAIL NO.:

MHT-FM-308A

REVISION DATE: 10/2013