



NOTES:

1. DETAILS TO BE USED IN CONJUNCTION WITH STANDARD GUIDE SPECIFICATIONS CONTAINING REQUIREMENTS FOR NAILERS, INSULATION, SLIPSHEETS, ETC.
2. PVC EDGE SEALANT IS REQUIRED ON ALL CUT OR NON-ENCAPSULATED EDGES OF REINFORCED MEMBRANE. THIS INCLUDES FACTORY CUT MEMBRANE.

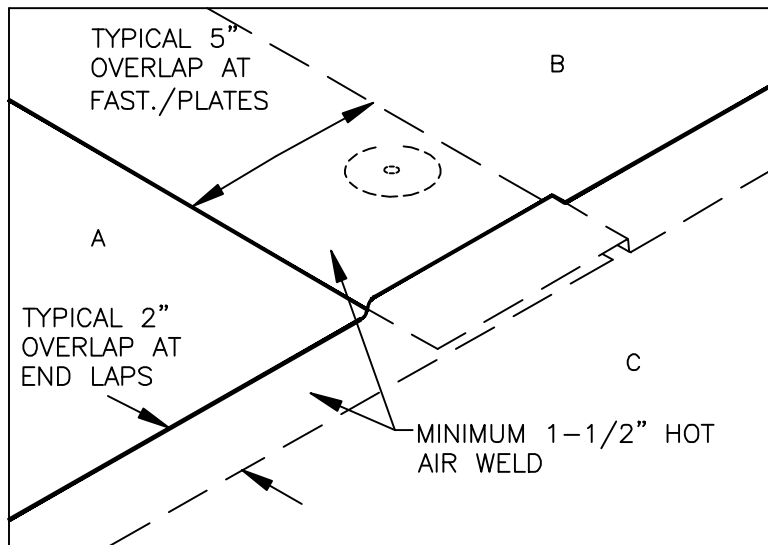

POSITION SHEETS AND HOT AIR WELD THE MEMBRANE A MINIMUM OF 1-1/2".

.050" (1.270 mm) OR .060" (1.524 mm) THICK MEMBRANES

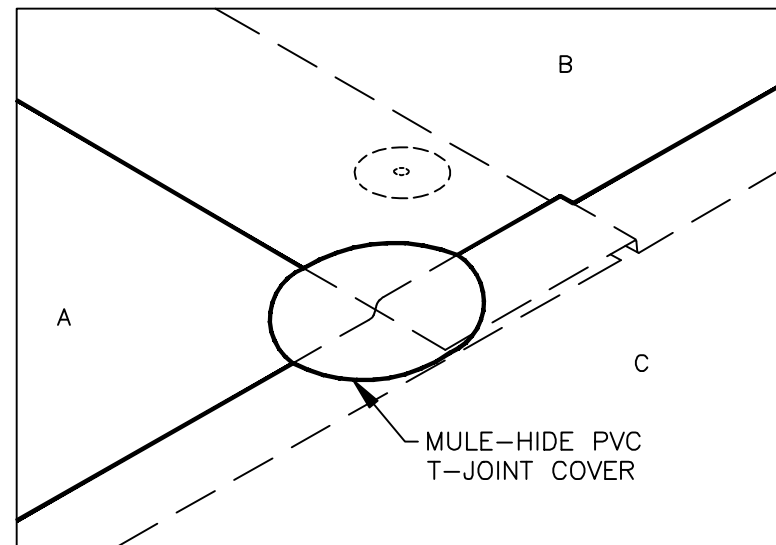

INSTALL A MULE-HIDE PVC T-JOINT COVER CENTERED OVER SPLICE INTERSECTION ("T-JOINT") AS SHOWN.

.080" (2.032 mm) THICK MEMBRANE ONLY

**MULE-HIDE
PRODUCTS CO., INC.
04/01/2007**

**SEAM INTERSECTION
SYSTEMS:
MECHANICALLY FASTENED PVC**

**DETAIL NO:
MHP-114**